
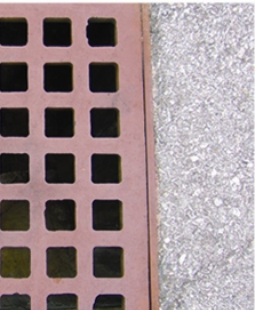


iSWM Criteria Manual for Site Development and Construction

City of Hurst
October 2012

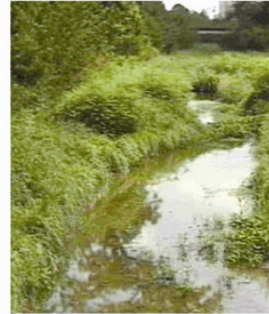

Overview of the iSWM Program

The iSWM Program for Construction and Development is a cooperative initiative that assists municipalities and counties to achieve their goals of water quality protection, streambank protection, and flood mitigation, while also helping communities meet their construction and post-construction obligations under state stormwater permits.

Development and redevelopment by their nature increase the amount of imperviousness in our surrounding environment. This increased imperviousness translates into loss of natural areas, more sources for pollution in runoff, and heightened flooding risks. To help mitigate these impacts, more than 60 local governments are cooperating to proactively create sound stormwater management guidance for the region through the *integrated* Stormwater Management (iSWM) Program.

The iSWM Program is comprised of four types of documentation and tools as shown in Figure 1. These are used to complement each other and to support the development process.

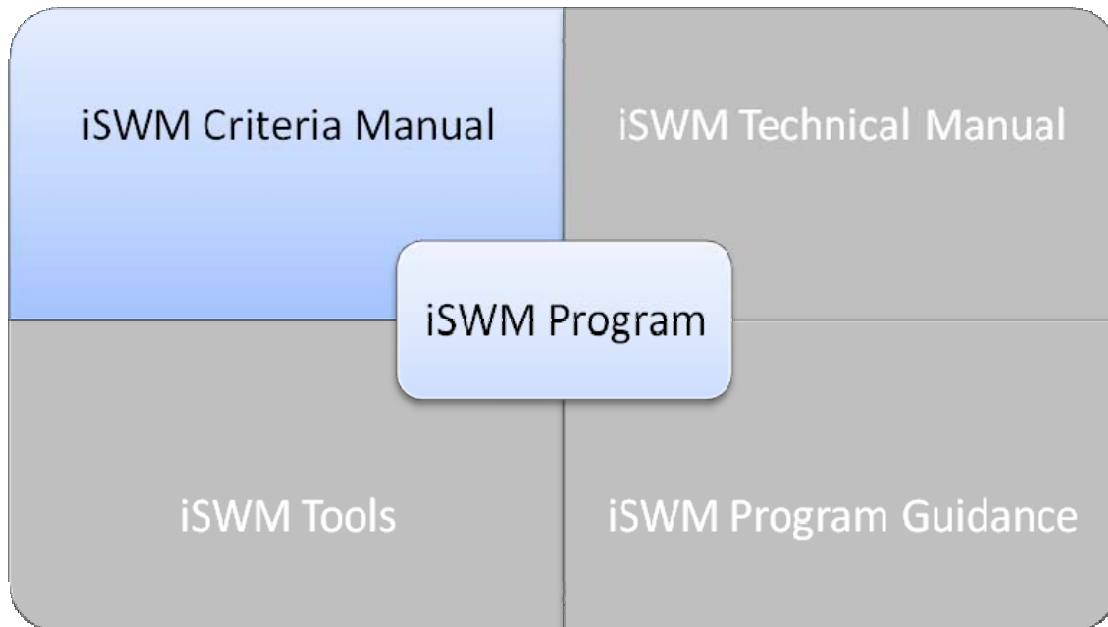


Figure 1: iSWM Program Support Documents and Tools

The four parts of iSWM are:

- iSWM Criteria Manual – This document provides a description of the development process, the iSWM focus areas and locally adopted design criteria allowing municipalities a flexible approach to apply at a local level.
- iSWM Technical Manual – This set of document provides technical guidance including equations, descriptions of methods, fact sheets, etc. necessary for design.
- iSWM Tools – This includes web-served training guides, examples, design tools, etc. that could be useful during design.
- iSWM Program Guidance – This includes reference documents that guide programmatic planning rather than technical design.

Table of Contents

1.0 Overview of iSWM Criteria Manual	1
1.1 Introduction.....	1
1.2 <i>integrated</i> Development Process	4
1.3 <i>integrated</i> Design Criteria	4
1.4 <i>integrated</i> Construction Criteria	7
2.0 <i>integrated</i> Development Process	8
2.1 Planning	8
2.2 Steps in the Development Process	8
3.0 <i>integrated</i> Design Criteria	14
3.1 Hydrologic Methods	14
3.1.1 Types of Hydrologic Methods.....	14
3.1.2 Rainfall Estimation.....	17
3.2 Water Quality Protection	17
3.2.1 Introduction.....	17
3.2.2 Option 1: <i>integrated</i> Site Design Practices and Credits.....	17
3.2.3 Option 2: Treat the Water Quality Protection Volume.....	22
3.2.4 Option 3: Assist with Off-Site Pollution Prevention Programs and Activities	26
3.3 Acceptable Downstream Conditions	26
3.4 Streambank Protection.....	27
3.5 Flood Mitigation	29
3.5.1 Introduction.....	29
3.5.2 Flood Mitigation Design Options	29
3.6 Stormwater Conveyance Systems.....	30
3.6.1 Introduction.....	30
3.6.2 Hydraulic Design Criteria for Streets and Closed Conduits	30
3.6.3 Hydraulic Design Criteria for Structures.....	33
3.7 Easements, Plats, and Maintenance Agreements	45
3.8 Stormwater Control Selection	47
3.8.1 Control Screening Process	47
4.0 <i>integrated</i> Construction Criteria.....	63
4.1 Applicability	63
4.2 Introduction.....	63
4.3 Criteria for BMPs during Construction	64

4.3.1	Erosion Controls.....	65
4.3.2	Sediment Controls.....	66
4.3.3	Material and Waste Controls.....	68
4.3.4	Installation, Inspection and Maintenance.....	70
5.0 Additional Local Requirements		71
5.1	Definitions.....	72
5.2	City of Hurst Development Process	73
5.2.1	Development Process Flowchart	73
5.2.2	Development Process Checklists.....	75
5.3	Tarrant County Rainfall Data.....	92
5.4	Runoff Coefficients for Rational Method	93
5.5	Structural Controls in Series	94
5.6	City of Hurst Draft Water Quality Option 1:	95
5.7	Example Storm Drain Line Designations and Call Outs	97

List of Tables

Table	Name	Page
1.1	iSWM Applicability.....	2
1.2	Storm Events.....	5
1.3	Summary of Options for Design Focus Areas.....	6
3.1	Applications of the Recommended Hydrologic Methods.....	15
3.2	Constraints on Using Recommended Hydrologic Methods.....	16
3.3	Integration of Site Design Practices with Site Development Process.....	19
3.4	<i>integrated</i> Site Design Point Requirements.....	20
3.5	Point System for <i>integrated</i> Site Design Practices.....	21
3.6	Suitability of Stormwater Controls to Meet <i>integrated</i> Focus Areas.....	25
3.7	Flow Spread Limits.....	31
3.8	Desirable Velocity in Storm Drains.....	32
3.9	Access Manhole Spacing Criteria.....	32
3.10	Roughness Coefficients (Manning's n) and Allowable Velocities for Natural Channels.....	35
3.11	Maximum Velocities for Vegetative Channel Linings.....	36
3.12	Classification of Vegetal Covers as to Degrees of Retardance.....	37
3.13	Recommended Loss Coefficients for Bridges.....	40
3.14	Closed Conduit Easements.....	45
3.15	Stormwater Treatment Suitability.....	49
3.16	Water Quality Performance.....	50
3.17	Site Applicability.....	51
3.18	Implementation Considerations.....	52
3.19	Physiographic Factors.....	55

3.20	Soils.....	56
3.21	Special Watershed Considerations.....	57
3.22	Location and Permitting Checklist.....	59
4.1	Requirements for Materials and Wastes.....	66

List of Figures

Figure	Name	Page
1.1	iSWM Applicability Flowchart.....	3
2.1	iSWM Flowchart.....	9

1.0 Overview of iSWM Criteria Manual

This Chapter discusses the criteria aspects of iSWM and lays out the framework and specific requirements. Local governments may modify this section to meet any local provisions.

1.1 Introduction

The purpose of this manual is to provide design guidance and a framework for incorporating effective and environmentally sustainable stormwater management into the site development and construction processes and to encourage a greater regional uniformity in developing plans for stormwater management systems that meet the following goals:

- Control runoff within and from the site to minimize flood risk to people and properties;
- Assess discharges from the site to minimize downstream bank and channel erosion; and
- Reduce pollutants in stormwater runoff to protect water quality and assist communities in meeting regulatory requirements.

Following criteria provided in the manual will help to meet sustainable development goals. There are many ways that sustainable development may be achieved while following these criteria. For example, a development that reduces individual lot imperviousness and a development that has high lot density in one area and a large open space in another can both meet sustainable requirements.

Chapter Summary

The iSWM Criteria Manual consists of five chapters:

Chapter 1 – Introduction and Summary

Chapter 2 – *integrated* Development Process

Chapter 3 – *integrated* Design Criteria

Chapter 4 – *integrated* Construction Criteria

Chapter 5 – Additional Local Provisions

Local Provision Boxes

Throughout this manual you will notice “Local Provision” boxes. These boxes are used by a local government to add, delete, or modify sections of the criteria and specify the options allowed and/or required by the local government. Additional local information can be added and will be located in Chapter 5.

Local Provisions:

This Criteria Manual has been adopted by the City of Hurst. **Information provided in the Local Provision Boxes and in Chapter 5 supersedes or supplements the text within the Criteria Manual. Tables in the Criteria Manual may not be effective based on the information in the corresponding Local Provision Boxes.**

For the Technical Manual and other iSWM Tools, please visit <http://iswm.nctcog.org>.

In the event that the City of Hurst ordinances conflict with this iSWM Criteria Manual, the City's ordinances supersede this manual.

Applicability

iSWM is applicable under the following conditions for development and redevelopment that will ultimately disturb one or more acres as illustrated below and in Figure 1.1:

Table 1.1 iSWM Applicability	
Applicable for iSWM Site Design:	Applicable for iSWM Construction:
<p>Land disturbing activity of 1 acre or more</p> <p style="text-align: center;">OR</p> <p>land disturbing activity of less than 1 acre where the activity is part of a common plan of development that is one acre or larger.</p>	<p>Land disturbing activity of 1 acre or more</p> <p style="text-align: center;">OR</p> <p>land disturbing activity of less than 1 acre where the activity is part of a common plan of development that is one acre or larger.</p>

A common plan of development consists of construction activity that is completed in separate stages, separate phases, or in combination with other construction activities.

Development and redevelopment are not specifically defined in this manual. The applicability is based on land disturbance activities. If an existing site has been cleared and graded, but not developed, within five years of the date of the developer's initial application submittal, the developer must consider the land conditions prior to the clearing and grading to be the existing site conditions.

New development or redevelopment in critical or sensitive areas, or as identified through a watershed study or plan, may be subject to additional performance and/or regulatory criteria as specified by the local government. Furthermore, these sites may need to utilize certain structural controls in order to protect a special resource or address certain water quality or drainage problems identified for a drainage area or watershed.

Site Design below Applicable Criteria

Site developments that do not meet the applicability requirements are not subject to the regulatory water quality or streambank protection requirements. However, it is recommended that these criteria still be used and that temporary controls be provided during construction. Flood mitigation and conveyance criteria still apply. The planning process is also simplified for sites below the applicable criteria to an optional pre-development review before the final submittal of the engineering plans.

Local Provisions:

Redevelopment Applicability for Water Quality:

For land disturbing activity of 1 acre or more including common plans of development greater than 1 acre, water quality mitigation will become required when:

- 1) Impervious area is increased on the site
- or
- 2) When landscaping improvements are required. (Zoning Ord. Chapter 27-21(i)(2))

The water quality mitigation will only be applied to the disturbed area and/or the added impervious area, not the entire site.

Flood mitigation and conveyance is required for all new developments sites, regardless of size.

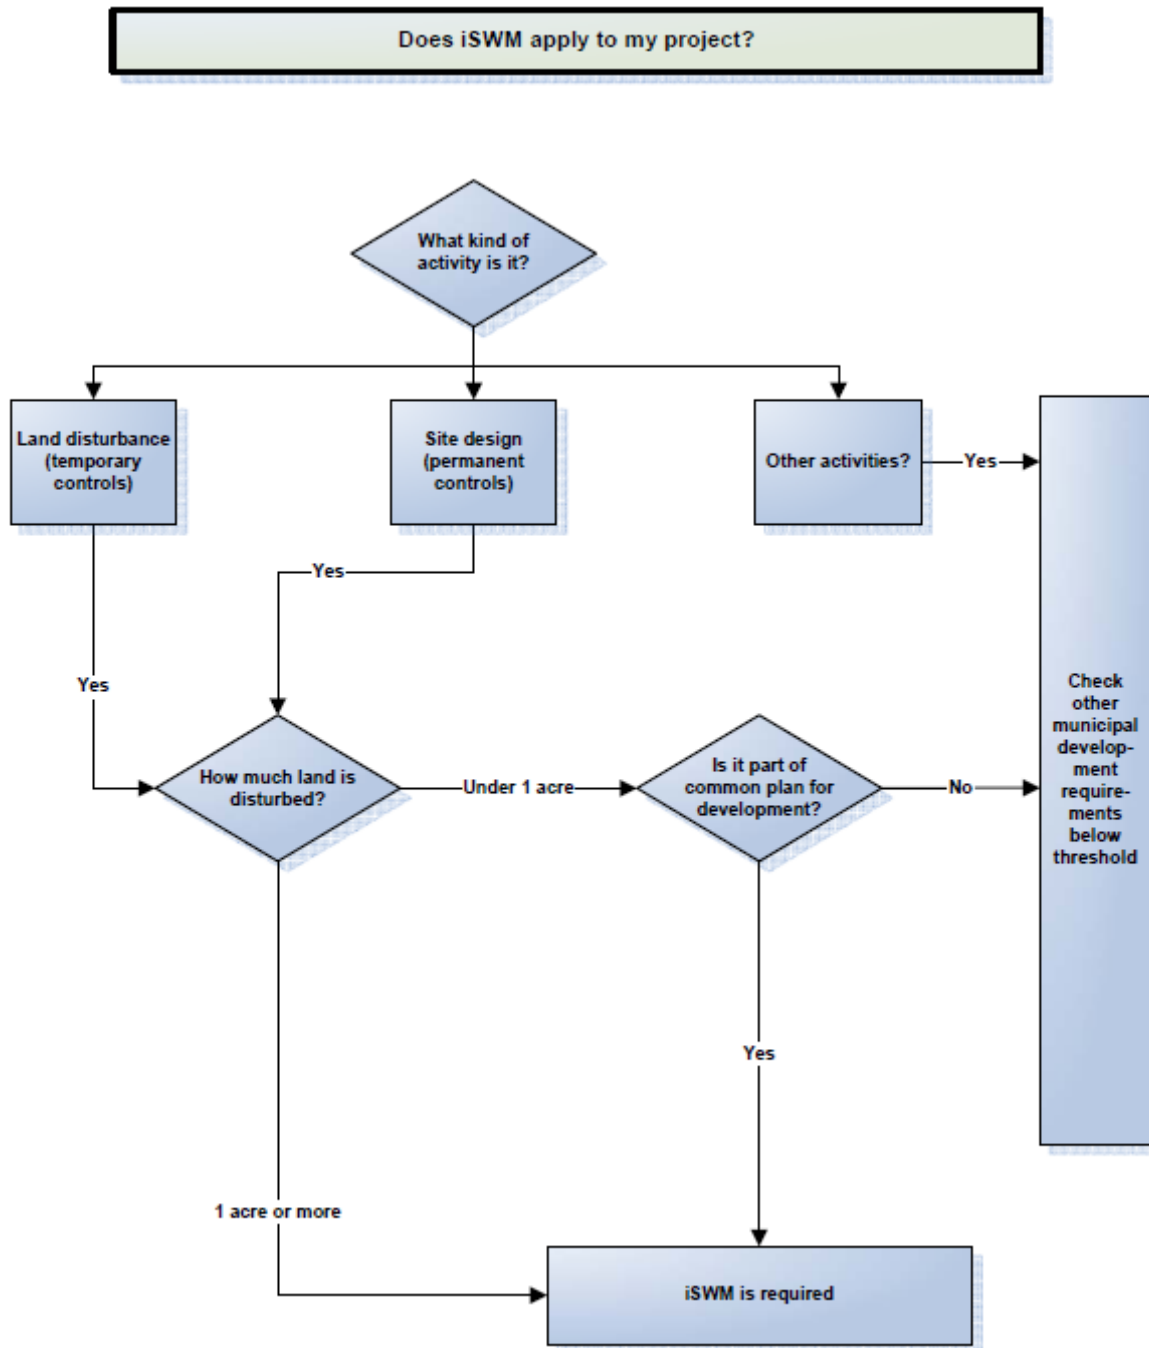


Figure 1.1 iSWM Applicability Flowchart

1.2 *integrated* Development Process

Chapter 2 of this manual presents details for completing the full iSWM development process which consists of five steps. Each of the steps builds on the previous steps to result in Final iSWM Plans and Construction Plans.

Step 1 – Review Local Requirements and Municipality’s Processes

Step 2 – Collect Data and Perform Site Analysis

Step 3 – Prepare Concept/Preliminary iSWM Plans

Step 4 – Prepare Final iSWM Plans and iSWM Construction Plan

Step 5 – Prepare Operation and Maintenance Plans

Local Provisions:

The “iSWM Plans” are the same as the engineering plans with additional features shown to meet iSWM requirements.

1.3 *integrated* Design Criteria

Chapter 3 of this manual presents an *integrated* approach for meeting stormwater runoff quality and quantity management goals by addressing the key adverse impacts of development on stormwater runoff. Its framework consists of three focus areas, each with options in terms of how the focus area is applied.

Design Focus Areas

The stormwater management focus areas and goals are:

- **Water Quality Protection:** Remove pollutants in stormwater runoff to protect water quality
- **Streambank Protection:** Regulate discharge from the site to minimize downstream bank and channel erosion
- **Flood Mitigation and Conveyance:** Control runoff within and from the site to minimize flood risk to people and properties for the conveyance storm as well as the 100-year storm.

Each of the Design Focus Areas must be used in conjunction with the others to address the overall stormwater impacts from a development site. When used as a set, the Design Focus Areas control the entire range of hydrologic events, from the smallest runoff-producing rainfalls up to the 100-year, 24-hour storm.

Local Provisions:

No Local Provisions are added.

Design Storms

Integrated design is based on the following four (4) storm events.

Storm Event Name	Storm Event Description
"Water Quality"	Criteria based on a volume of 1.5 inches of rainfall, not a storm frequency
"Streambank Protection"	1-year, 24-hour storm event
"Conveyance"	25-year, 24-hour storm event
"Flood Mitigation"	100-year, 24-hour storm event

Throughout the manual the storms will be referred to by their storm event names.

Local Provisions:	
The City of Hurst uses the following storm event table:	
Table 1.2 City of Hurst Storm Events	
Storm event Name	Storm event Description
"Water Quality"	Criteria Based on a volume of 1.5 inches of rainfall, not a storm frequency
"Streambank Protection"	1-year, 24-hour storm event
"Conveyance"	10-year, 24-hour storm event
"Flood Mitigation"	100-year, 24-hour storm event
<p>Pipe Systems: For storm sewer pipes 27" or smaller the design frequency shall be the Conveyance storm with the energy grade line contained within the right-of-way. Positive overflow must be routed to convey storm flow not captured in the Flood Mitigation storm. Larger pipe systems will be designed to the Flood Mitigation storm with the energy grade line contained within the right-of-way.</p> <p>For all other facilities: For culverts, bridges, channels, creeks, and detention/retention facilities the design frequency will be the Flood Mitigation storm with the Streambank Protection and Conveyance storms being analyzed for any negative impacts.</p> <p>All building elevations adjacent to any overflow must be set to a lowest floor elevation of 1 foot above the hydraulic grade line elevation.</p>	

Design Focus Area Application Options

There are multiple options provided to meet the required criteria for water quality protection, streambank protection, and flood mitigation. These design options are summarized in Table 1.3.

Design criteria for streambank protection and flood mitigation are based on a **downstream assessment**. The purpose of the downstream assessment is to protect downstream properties and channels from increased flooding and erosion potential due to upstream development. A downstream assessment is

required to determine the extent of improvements necessary for streambank protection and flood mitigation. Downstream assessments shall be performed for streambank protection, conveyance, and flood mitigation storm events. More information on downstream assessments is provided in Section 3.3.

If a development causes no adverse impacts to existing conditions, then it is possible that little or no mitigation would be required.

Design Focus Area	Reference Section	Required Downstream Assessment	Design Options
Water Quality Protection	3.2	no	Option 1: Use <i>integrated</i> Site Design Practices for conserving natural features, reducing impervious cover, and using the natural drainage systems
			Option 2: Treat the Water Quality Protection Volume (WQ _v) by reducing total suspended solids from the development site for runoff resulting from rainfalls of up to 1.5 inches (85 th percentile storm)
			Option 3: Assist in implementing off-site community stormwater pollution prevention programs/activities as designated in an approved stormwater master plan or TPDES Stormwater permit
Streambank Protection	3.4	yes	Option 1: Reinforce/stabilize downstream conditions
			Option 2: Install stormwater controls to maintain or improve existing downstream conditions
			Option 3: Provide on-site controlled release of the 1-year, 24-hour storm event over a period of 24 hours (Streambank Protection Volume, SP _v)
Flood Mitigation and Conveyance	3.5 and 3.6	yes	Flood Mitigation
			Option 1: Provide adequate downstream conveyance systems
			Option 2: Install stormwater controls on-site to maintain or improve existing downstream conditions
			Option 3: In lieu of a downstream assessment, maintain existing on-site runoff conditions
			Conveyance
			Minimize localized site flooding of streets, sidewalks, and properties by a combination of on-site stormwater controls and conveyance systems

Local Provisions:

See Chapter 3 Local Provision Boxes for details concerning the Design Focus Area Options.

1.4 *integrated* Construction Criteria

Chapter 4 of this manual presents an *integrated* approach for reducing the impact of stormwater runoff from construction activities on downstream natural resources and properties. The purpose is to provide design criteria for temporary controls during construction that protect water quality by:

- Preventing soil erosion;
- Capturing sediment on-site when preventing erosion is not feasible due to construction activities; and
- Controlling construction materials and wastes to prevent contamination of stormwater.

Temporary controls to protect water quality are known as Best Management Practices (BMPs). The design of the BMPs is to be coordinated with and done at the same time as the Preliminary and Final iSWM Plans. Construction BMPs complement and work with the site grading and drainage infrastructure.

Erosion Control BMPs are designed to minimize the area of land disturbance and to protect disturbed soils from erosion. Protection can be accomplished by diverting stormwater away from the disturbed area or by stabilizing the disturbed soil. Erosion control BMPs are most important on disturbed slopes and channels where the potential for erosion is greatest. The design of erosion control BMPs must be coordinated with related grading, drainage and landscaping elements. (e.g. channel armoring, velocity dissipaters, etc.)

Sediment Control BMPs are temporary structures or devices that capture soil transported by stormwater. The BMPs are designed to function effectively with the site drainage patterns and infrastructure. An effective design ensures that the sediment control BMPs do not divert flow or flood adjacent properties and structures. Some types of permanent drainage structures, such as retention basins, can also be designed to function as a sediment control BMP during construction.

Material and Waste Control BMPs prevent construction materials and wastes from coming into contact with and being transported by stormwater. These BMPs consist of a combination of notes to direct contractor and temporary construction controls.

The iSWM Construction Criteria are the minimum requirements for temporary controls during construction. The state permit and requirements for stormwater discharges associated with construction activities must also be followed. More information on state requirements is provided in Section 4.2.

Local Provisions:

No Local Provisions are added.

2.0 *integrated* Development Process

This Chapter discusses the five-step development process. Local governments will integrate these processes into their current process by the addition of local provisions.

2.1 Planning

A formal *integrated* Stormwater Management Development Process shall be implemented to meet the stormwater management goals and to see that local stormwater guidelines and requirements are implemented. The process shall include the steps, meetings, and documents that must be met by the developer. The five-step process described herein includes the following:

- The iSWM Plans: The iSWM Plans are the documents that summarize the data collected in steps 1 and 2 and are shown on the conceptual/preliminary and final plans that must be submitted to the municipality as part of steps 3, 4, and 5. Each submittal must follow the criteria outlined in Chapters 2 and 3. Submittals shall include information in accordance with the checklists that are included in Chapter 5.
- The iSWM Construction Plan: The iSWM Construction Plan is the document that uses data collected in steps 1 and 2 to protect water quality during construction. It is submitted to the municipality with the Final iSWM Plans in Step 4. An overview of the iSWM construction plan content is covered in Section 2.2. More detailed criteria for the iSWM Construction Plan are outlined in Chapter 4.

The iSWM Plans and iSWM Construction Plan are a subset of the overall development process that occurs throughout the planning and development cycle of a project and then continues after construction is completed via regular inspection and maintenance of the stormwater management system.

In addition to these plans, stormwater master plans are an important tool used to assess and prioritize both existing and potential future stormwater problems and to consider alternative stormwater management solutions. Local governments may have individual watershed plans, or several governments may work cooperatively to develop a unified approach to watershed planning, development controls, permit compliance, multi-objective use of floodplain and other areas, and property protection. Refer to the Local Provisions in Step 1 under Section 2.2 where regional approaches (if any) are identified.

2.2 Steps in the Development Process

This section describes the typical contents and general procedure for preparing iSWM Plans and the iSWM Construction Plan. The level of detail involved in the plans will depend on the project size and the individual site and development characteristics. Figure 2.1 lays out the five-step process. Each of the following steps builds on the previous steps to result in the Final iSWM Site and Construction Plans:

- Step 1 – Review Local Requirements and Municipality’s Processes
- Step 2 – Collect Data and Perform Site Analysis
- Step 3 – Prepare Concept/Preliminary iSWM Plans
- Step 4 – Prepare Final iSWM Plans and iSWM Construction Plan
- Step 5 – Prepare Operation and Maintenance Plans

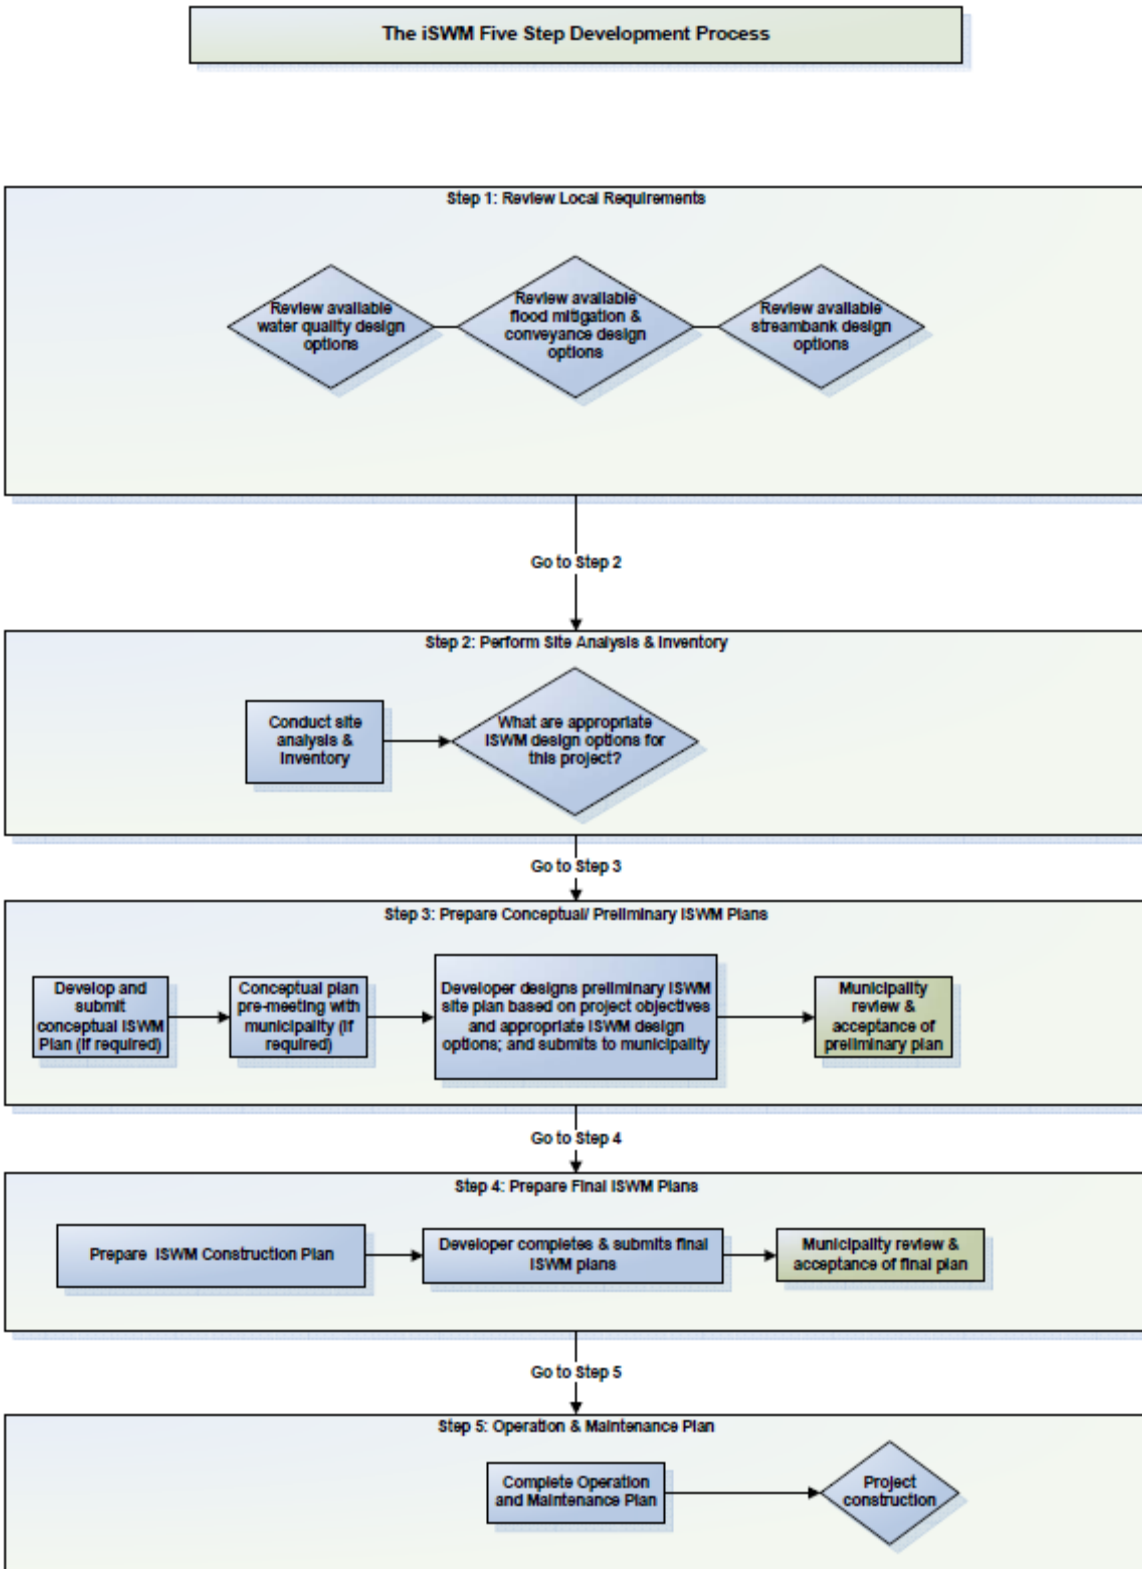


Figure 2.1 iSWM Flowchart

Step 1 – Review Local Requirements and Municipality Processes

The site developer shall become familiar with the local stormwater management, development requirements and design criteria that apply to the site. These requirements include:

- iSWM Criteria Manual for Site Development and Construction (this manual including all local provisions)
- Available online iSWM Program documents
 - iSWM Technical Manual
 - iSWM Tools
 - iSWM Program Guidance
- State and Federal Regulatory Requirements
- Other Local Municipal Ordinances and Criteria
 - Platting Procedures
 - Zoning Requirements
 - Development Codes and Procedures
 - Tree and Landscape Requirements
 - Special Use Permits
 - Drainage Master Plans and Watershed Plans
 - Erosion Control Plans
 - Floodplain Ordinances
 - Grading Plan Requirements
 - Construction/Building Permit Notifications and Requirements

Information regarding the above items can be obtained from this manual or at a pre-submittal (or similar) meeting with the municipality.

A critical part of any project involves the proposed development working closely with various departments within the municipality. Integrating the stormwater practices with other regulatory requirements will promote a sustainable development.

Opportunities for special types of development (e.g., clustering) or special land use opportunities (e.g., conservation easements or tax incentives) must be investigated. In addition, there may be an ability to partner with a local community for the development of greenways or other riparian corridor or open space developments.

All applicable State and Federal regulatory requirements must be met.

Local Provisions:

Figure 2.1 is not used by the City of Hurst. See the updated Figure 5.1 in Chapter 5 for the City's development flowchart. Use the checklists that are provided in Chapter 5 as a guide for elements to be shown on plans/plats throughout the development process.

Information regarding the above items is available on the City's website. If additional information is needed it may be requested from the Public Works Director or designee by the developer.

Step 2 – Collect Data and Perform Site Analysis

Using field and mapping techniques approved by the municipality, the site engineer shall collect and review information on the existing site conditions and map the following site features:

- Topography
- Drainage patterns and basins
- Intermittent and perennial streams on-site and
- Property lines, adjacent areas and easements

- off-site waters that will receive discharges from the proposed development
- Soil types and their susceptibility to erosion
- Ground cover and vegetation, particularly unique or sensitive vegetation areas to be protected during development
- Existing development
- Existing stormwater facilities on-site and off-site facilities that will receive discharges from the proposed development
- Wetlands and critical habitat areas
- Boundaries of wooded areas and tree clusters
- Floodplain boundaries
- Steep slopes
- Required buffers and setbacks along water bodies
- Proposed stream crossing locations
- Other required protection areas

The site analysis shall be summarized in the conceptual/preliminary iSWM Plans along with any other supporting documents. The data collected and analyzed during this step of the development process shall be used as the starting point for preparing the iSWM Plans and the iSWM Construction Plan.

Local Provisions:

Data collected under Step 2 shall be shown on a Conceptual iSWM Plan (a.k.a Concept Plan) that will be submitted at the Pre-Development Conference during Step 3. The Concept Plan Checklist in Chapter 5 provides a detailed list of the items that shall be shown at the Pre-Development Conference.

Step 3 –Prepare Conceptual/Preliminary iSWM Plans

Conceptual iSWM Plan

Based on the review of existing conditions and site analysis, the design engineer shall develop and submit a Conceptual iSWM Plan for the project. The Conceptual iSWM Plan allows the design engineer to propose a potential site layout and gives the developer and local review authority a “first look” at the stormwater management system for the proposed development.

The following steps shall be followed in developing the Conceptual iSWM Plan with the help of the Checklist for Conceptual iSWM Plans found in Chapter 5 of this manual:

- Use *integrated* Site Design Practices (Section 3.2.2) as applicable to develop the site layout, including:
 - Preserving the natural feature conservation areas defined in the site analysis
 - Fitting the development to the terrain and minimizing land disturbance
 - Reducing impervious surface area through various techniques
 - Preserving and utilizing the natural drainage system wherever possible
- Determine the credits for *integrated* Site Design (Section 3.2.2) and water quality volume reduction (Section 3.2.3) as applicable, to be accounted for in the design of structural and non-structural stormwater controls on the site.
- Calculate conceptual estimates of the locally required focus area design requirements for water quality protection, streambank protection, and flood mitigation (Sections 3.2, 3.4, 3.5) based on the conceptual plan site layout.
- Perform screening and conceptual selection of appropriate temporary and permanent structural stormwater controls (Section 3.8 and Section 4.0) and identification of potential site locations.

It is extremely important at this stage that stormwater system design is integrated into the overall site design concept in order to best and most cost-effectively reduce the impacts of the development as well as provide for the most cost-effective and environmentally sensitive approach. Using hydrologic calculations, the goal of mimicking pre-development conditions can serve a useful purpose in planning the stormwater management system.

Local Provisions:

This step refers to the Pre-Development Conference in the City of Hurst at which time a Concept Plan will be submitted. The Concept Plan Checklist in Chapter 5 provides a list of the items that must be shown at the Pre-Development Conference.

Preliminary iSWM Plans

The Preliminary iSWM Plan ensures that requirements and criteria are complied with and opportunities are taken to minimize adverse impacts from the development. This step builds on the data developed in the Conceptual iSWM Plan by refining and providing more detail to the concepts identified. If no Conceptual Plan is submitted, it shall be part of the Preliminary iSWM Plan. The checklist for Preliminary iSWM Plan in Chapter 5 outlines the data that shall be included in the preliminary iSWM Plan.

The Preliminary iSWM Plan shall consist of maps, plan sheets, narrative, and supporting design calculations (hydrologic and hydraulic) for the proposed stormwater management system. The completed Preliminary iSWM Plan shall be submitted to the local review authority for review and comment.

Local Provisions:

The submission of the preliminary site plan and preliminary engineering plans will include all the necessary iSWM features. The Preliminary Site Plan and Preliminary Engineering Plan Checklists in Chapter 5 provide a list of items that shall be shown.

Step 4 – Prepare Final iSWM Plans and iSWM Construction Plan

The Final iSWM Plans and iSWM Construction Plan shall be prepared together and submitted to the local review authority for approval prior to any soil disturbance or other construction activities on the development site. The Final iSWM Plans add further detail to the Preliminary iSWM Plan and reflect changes that are requested or required by the local review authority.

The Final iSWM Plans and iSWM Construction Plan, as outlined in the final iSWM Plan checklist in Chapter 5, shall include all of the revised elements of the Preliminary iSWM Plans as well as a landscape plan, operation and maintenance plan, and any permits/waiver requests.

Local Provisions:

The submission of the final plat and final engineering plans will include all the necessary iSWM features. The Final Site Plan and Final Engineering Plan Checklists in Chapter 5 provide a list of items that shall be shown.

Step 5 – Complete Operations and Maintenance Plan

An Operations and Maintenance Plan shall be developed in accordance with this section. The plan shall be included in the Final iSWM Plan. It needs to clearly state which entity has responsibility for operation and maintenance of temporary and permanent stormwater controls and drainage facilities to ensure they function properly from the time they are first installed.

The Operations and Maintenance Plan shall include but is not limited to:

- Responsible party for all tasks in the plan
- Inspection and maintenance requirements
- Maintenance of permanent stormwater controls and drainage facilities during construction
- Cleaning and repair of permanent stormwater controls and drainage facilities before transfer of ownership
- Frequency of inspections for the life of the permanent structures
- Funding source for long-term maintenance
- Description of maintenance tasks and frequency of maintenance
- Access and safety issues
- Maintenance easements
- Reviewed and approved maintenance agreements
- Testing and disposal of sediments
- Life span of structures and replacement as needed

Guidance for development of Operations and Maintenance Plans has been provided with each temporary and permanent Best Management Practice (BMP) included in the *Stormwater Controls Technical Manual* sections.

Local Provisions:

An Operations and Maintenance Plan shall be shown on the Final Engineering Plans. The requirements of the Operations and Maintenance Plan are dependent on the permanent controls on the site and must include at a minimum the items listed in Step 5.

3.0 *integrated* Design Criteria

This chapter gives details on criteria to meet the three focus areas of water quality, stream bank protection and flood mitigation, as well as information supportive of hydrology and stormwater conveyance.

3.1 Hydrologic Methods

3.1.1 *Types of Hydrologic Methods*

There are a number of empirical hydrologic methods available to estimate runoff characteristics for a site or drainage sub basin. However, the following methods have been selected to support hydrologic site analysis for the design methods and procedures included in this manual:

- Rational Method
- SCS Unit Hydrograph Method
- Snyder's Unit Hydrograph Method
- USGS & TXDOT Regression Equations
- iSWM Water Quality Protection Volume Calculation
- Water Balance Calculations

Table 3.1 lists the hydrologic methods and the circumstances for their use in various analysis and design applications. Table 3.2 provides some limitations on the use of several methods.

In general:

- The Rational Method is acceptable for small, highly impervious drainage areas, such as parking lots and roadways draining into inlets and gutters.
- The U.S. Geological Survey (USGS) and Texas Department of Transportation (TXDOT) regression equations are acceptable for drainage areas with characteristics within the ranges given for the equations shown in Table 3.2. These equations should not be used when there are significant storage areas within the drainage basin or where other drainage characteristics indicate general regression equations are not appropriate.

Local Provisions:

The City of Hurst allows the limited use of USGS and TXDOT Regression Equations for projects on state or federal property. Contact the Public Works Director or designee for written approval to use these methods.

All other hydrologic methods are allowed.

Method	Rational Method	SCS Method	Modified Rational	Snyder's Unit Hydrograph	USGS / TXDOT Equations	iSWM Water Quality Volume Calculation
Water Quality Protection Volume (WQ _v)						✓
Streambank Protection Volume (SP _v)		✓		✓		
Flood Mitigation Discharge (Q _f)		✓		✓	✓	
Storage Facilities		✓	✓	✓		
Outlet Structures		✓		✓		
Gutter Flow and Inlets	✓					
Storm Drain Pipes	✓	✓		✓		
Culverts	✓	✓		✓	✓	
Bridges		✓		✓		
Small Ditches	✓	✓		✓		
Open Channels		✓		✓	✓	
Energy Dissipation		✓		✓		

Local Provisions:

The City of Hurst allows the Rational Method for Flood Mitigation Discharge, outlet structures, bridges, open channels, and energy dissipation in addition to the items checked in Table 3.1 provided the drainage areas meet the constraints in Table 3.2.

Method	Size Limitations¹	Comments
Rational	0 – 100 acres	Method can be used for estimating peak flows and the design of small site or subdivision storm sewer systems.
Modified Rational ²	0 – 200 acres	Method can be used for estimating runoff volumes for storage design.
Unit Hydrograph (SCS) ³	Any Size	Method can be used for estimating peak flows and hydrographs for all design applications.
Unit Hydrograph (Snyder's) ⁴	1 acre and larger	Method can be used for estimating peak flows and hydrographs for all design applications.
TXDOT Regression Equations	10 to 100 mi ²	Method can be used for estimating peak flows for rural design applications.
USGS Regression Equations	3 – 40 mi ²	Method can be used for estimating peak flows for urban design applications.
iSWM Water Quality Protection Volume Calculation	Limits set for each Structural Control	Method can be used for calculating the Water Quality Protection Volume (WQ _v).

¹ Size limitation refers to the drainage basin for the stormwater management facility (e.g., culvert, inlet).

² Where the Modified Rational Method is used for conceptualizing, the engineer is cautioned that the method could underestimate the storage volume.

³ This refers to SCS routing methodology included in many readily available programs (such as HEC-HMS or HEC-1) that utilize this methodology.

⁴ This refers to the Snyder's methodology included in many readily available programs (such as HEC-HMS or HEC-1) that utilize this methodology.

Local Provisions:

Rational Method runoff coefficients for the City of Hurst are provided in Chapter 5.

Snyder's Unit Hydrograph method size limitations are 1 square mile or greater.

All other size limitations are applicable in the City of Hurst.

3.1.2 Rainfall Estimation

Rainfall intensities are provided in *Section 5.0 of the Hydrology Technical Manual* for the nine (9) counties within the North Central Texas Council of Governments. The intensities are based on a combination of data from Hydro-35 and USGS. These intensities shall be used for all hydrologic analysis within the applicable county.

Local Provisions:

For Rational and Modified Rational the rainfall intensity shall be determined using the Tarrant County rainfall intensity tables in Section 5.0 of the Hydrology Technical Manual which is also provided in Chapter 5 of this Criteria Manual.

For drainage areas 1 acre or less a time of concentration of 10 minutes may be used as a design basis.

For the SCS Unit Hydrograph method a Type II rainfall distribution shall be used as defined in the USDA TR-55 for Tarrant County.

3.2 Water Quality Protection

3.2.1 Introduction

iSWM requires the use of *integrated* Site Design Practices as the primary means to protect the water quality of our streams, lakes, and rivers from the negative impacts of stormwater runoff from development. The *integrated* Site Design Practices shall be designed as part of the iSWM Plans. In addition to the *integrated* Site Design Practices, required water quality protection can be achieved by two additional options: (1) by treating the water quality protection volume and (2) assisting with off-site pollution prevention activities. These three approaches are described below.

Local Provisions:

No Local Provisions are added.

3.2.2 Option 1: integrated Site Design Practices and Credits

The *integrated* Site Design Practices are methods of development that reduce the “environmental footprint” of a site. They feature conservation of natural features, reduced imperviousness, and the use of the natural drainage system. In this option, points are awarded for the use of different Site Design Practices. A minimum number of points are needed to meet the iSWM requirements for Water Quality. Additional points can be gained to qualify for development incentives.

List of *integrated* Site Design Practices and Techniques

Twenty *integrated* Site Design Practices are grouped into four categories listed below. Not all practices are applicable to every site.

Conservation of Natural Features and Resources

- Preserve Undisturbed Natural Areas
- Preserve Riparian Buffers
- Avoid Floodplains

- Avoid Steep Slopes
- Minimize Siting on Porous or Erodible Soils

Lower Impact Site Design Techniques

- Fit Design to the Terrain
- Locate Development in Less Sensitive Areas
- Reduce Limits of Clearing and Grading
- Utilize Open Space Development
- Consider Creative Designs

Reduction of Impervious Cover

- Reduce Roadway Lengths and Widths
- Reduce Building Footprints
- Reduce the Parking Footprint
- Reduce Setbacks and Frontages
- Use Fewer or Alternative Cul-de-Sacs
- Create Parking Lot Stormwater "Islands"

Utilization of Natural Features for Stormwater Management

- Use Buffers and Undisturbed Areas
- Use Natural Drainageways Instead of Storm Sewers
- Use Vegetated Swale Instead of Curb and Gutter
- Drain Rooftop Runoff to Pervious Areas

More detail on each site design practice is provided in the *integrated* Site Design Practice Summary Sheets in [Section 2.2 of the Planning Technical Manual](#).

Local Provisions:

DO NOT USE TABLES 3.4 and 3.5. The point system and point requirements in Tables 3.4 and 3.5 are not used by the City of Hurst. The City of Hurst has developed a point system for use within the City which is located in Chapter 5, Tables 5.1 to 5.3.

Water quality is a requirement and incentives will not be provided by the City.

Integration of Site Design Practices into Site Development Process

During the site planning process described in Chapter 2, there are several steps involved in site layout and design, each more clearly defining the location and function of the various components of the stormwater management system. To be most effective and easier to incorporate, *integrated* Site Design Practices should be part of this overall development process as outlined in Table 3.3.

Site Development Phase	Site Design Practice Activity
Site Analysis	<ul style="list-style-type: none"> • Identify and delineate natural feature conservation areas (natural areas and stream buffers) • Perform site reconnaissance to identify potential areas for and types of credits • Determine stormwater management requirements
Conceptual Plan	<ul style="list-style-type: none"> • Preserve natural areas and stream buffers during site layout • Reduce impervious surface area through various techniques • Identify locations for use of vegetated channels and groundwater recharge • Look for areas to disconnect impervious surfaces • Document the use of site design practices
Preliminary and Final Plan	<ul style="list-style-type: none"> • Perform layout and design of credit areas – integrating them into treatment trains • Ensure integrated Focus Areas are satisfied • Ensure appropriate documentation of site design credits according to local requirements
Construction	<ul style="list-style-type: none"> • Ensure protection of key areas • Ensure correct final construction of areas needed for credits • Inspect and maintain implementation of BMPs during construction
Final Inspection	<ul style="list-style-type: none"> • Develop maintenance requirements and documents • Ensure long term protection and maintenance • Ensure credit areas are identified on final plan and plat if applicable

Point System

All sites that meet iSWM applicability must provide on-site enhanced water quality protection. Under the *integrated* Site Design Practice option, sites that accumulate a minimum number of points by incorporating *integrated* Site Design Practices are considered to have provided enhanced water quality protection.

The point system is made up of three components:

1. The initial percentage of the site that has been previously disturbed sets the minimum requirement. This is shown in the left-hand column of Table 3.4.
2. A minimum required total of Water Quality Protection (WQP) points is needed to meet the basic water quality criteria. This minimum is shown in the center column of Table 3.4.
3. Optional additional points can be accumulated through additional use of Site Design Practices to be eligible for developer incentives. Each developer incentive attained requires ten (10) additional Site Design Practice points above the minimum required points as shown in the right-hand column of Table 3.4.

As shown in Table 3.4, the initial percentage of site disturbance sets the minimum required points necessary to meet Water Quality Protection criteria. If a developer wishes to go beyond this minimum then the number of additional points required to attain specific development incentives is also given.

Percentage of Site(by Area) with Natural Features Prior to Proposed Development	Minimum Required Points for Water Quality Protection (WQP)	Additional Points Above WQP for Development Incentives
> 50%	50	10 points each
20 - 50%	30	10 points each
< 20%	20	10 points each

The minimum number of points required to achieve WQP, as shown in the center column of Table 3.4, depends on the proportion of undisturbed natural features that exist on the site before it is developed. It is assumed that disturbing a site that has little previously disturbed area will cause more relative environmental impact than a site that has already incurred significant site disturbance. Therefore, disturbing a “pristine” site carries a higher restoration/preservation requirement.

For the purpose of this evaluation, undisturbed natural features are areas with one or more of the following characteristics:

- Unfilled floodplain
- Stand of trees, forests
- Established vegetation
- Steep sloped terrain
- Creeks, gullies, and other natural stormwater features
- Wetland areas and ponds

The number of points credited for the use of *integrated* Site Design Practices is shown in Table 3.5. To determine the qualifying points for a site, the developer must reference Table 3.5 and follow the guidance for each practice in the *Planning Technical Manual*.

Using the area of the site that is eligible for a practice as a basis, points are given for the percent of that area to which the *integrated* Site Design Practice is applied. For example, if a planned site has four (4) acres of riparian buffer and the developer proposes to preserve two (2) acres, then the site would qualify for 50 percent of the 8 credit points for iSWM Site Design Practice 2 (Preserve Riparian Buffers), because 50 percent of the site design practice was incorporated. The actual points earned for iSWM Site Design Practice 2 would be 4 points ($0.50 * 8 \text{ pts} = 4 \text{ pts}$). To comply with water quality protection and to apply for site design credits, the developer must submit the completed table and associated documentation or calculations to the review authority.

Table 3.5 Point System for <i>integrated</i> Site Design Practices				
iSWM Practice No.	Practice	Percent of Eligible Area Using Practice	Maximum Points	Actual Points Earned (% practice used * max. points)
Conservation of Natural Features and Resources				
1	Preserve/Create Undisturbed Natural Areas		8	
2	Preserve or Create Riparian Buffers Where Applicable		8	
3	Avoid Existing Floodplains or Provide Dedicated Natural Drainage Easements		8	
4	Avoid Steep Slopes		3	
5	Minimize Site on Porous or Erodible Soils		3	
Lower Impact Site Design				
6	Fit Design to the Terrain		4	
7	Locate Development in Less Sensitive Areas		4	
8	Reduce Limits of Clearing and Grading		6	
9	Utilize Open Space Development		8	
10	Incorporate Creative Design (e.g. Smart Growth, LEED Design, Form Based Zoning)		8	
Reduction of Impervious Cover				
11	Reduce Roadway Lengths and Widths		4	
12	Reduce Building Footprints		4	
13	Reduce the Parking Footprint		5	
14	Reduce Setbacks and Frontages		4	
15	Use Fewer or Alternative Cul-de-Sacs		3	
16	Create Parking Lot Stormwater "Islands"		5	
Utilization of Natural Features				
17	Use Buffers and Undisturbed Areas		4	
18	Use Natural Drainageways Instead of Storm Sewers		4	
19	Use Vegetated Swale Design		3	
20	Drain Runoff to Pervious Areas		4	
Subtotal – Actual site points earned			100	
Subtract minimum points required (Table 3.4)			-	
Points available for development incentives				
Add 1 point for each 1% reduction of impervious surface			+	
Total Points for Development Incentives				

Local Provisions:

DO NOT USE TABLES 3.4 and 3.5. The point system and point requirements in Tables 3.4 and 3.5 are not used by the City of Hurst. The City of Hurst has developed a point system for use within the City which is located in Chapter 5, Tables 5.1 to 5.3.

Water quality is a requirement and incentives will not be provided by the City.

Development Incentives

The developer can use *integrated* Site Design Practice points in excess of the minimum required for water quality protection to qualify for development incentives provided by the municipality. Additional points can be earned for redevelopment sites. Each reduction of one (1) percent imperviousness from existing conditions qualifies for one (1) site design point. The total points available for development incentives shall be calculated per Table 3.5. Each incentive requires ten (10) additional points above the minimum point required to meet water quality criteria, as stated in Table 3.4.

A list of available development incentives includes:

- Narrower pavement width for minor arterials
- Use of vegetated swales in lieu of curb and gutter for eligible developments
- Reduced ROW requirements, i.e. Sidewalk/Utility Easements
- Increased density in buildable area, floor area ratios, or additional units in buildable area
- Expedited Plans review and inspection
- Waiver or reduction of fees
- Local government public-private partnerships
- Waiver of maintenance, public maintenance
- Stormwater user fee credits or discounts
- Rebates, local grants, reverse auctions
- Low interest loans, subsidies, tax credits, or financing of special green projects
- Awards and recognition programs
- Reductions in other requirements

Local Provisions:

Water quality is a requirement and incentives will not be provided by the City.

3.2.3 Option 2: Treat the Water Quality Protection Volume

Treat the Water Quality Protection Volume by reducing total suspended solids from the development site for runoff resulting from rainfall of 1.5 inches (85th percentile storm). Stormwater runoff equal to the Water Quality Protection Volume generated from sites must be treated using a variety of on-site structural and nonstructural techniques with the goal of removing a target percentage of the average annual total suspended solids.

A system has been developed by which the Water Quality Protection Volume can be reduced, thus requiring less structural control. This is accomplished through the use of certain reduction methods, where affected areas are deducted from the site area, thereby reducing the amount of runoff to be treated. For more information on the Water Quality Volume Reduction Methods see [Section 1.3 of the Water Quality Technical Manual](#).

Water Quality Protection Volume

The Water Quality Protection Volume (WQ_v) is the runoff from the first 1.5 inches of rainfall. Thus, a stormwater management system designed for the WQ_v will treat the runoff from all storm events of 1.5 inches or less, as well as a portion of the runoff for all larger storm events. For methods to determine the WQ_v, see [Section 1.2 of the Water Quality Technical Manual](#).

Local Provisions:

The City of Hurst requires that the water quality volume be rated for at least 70% removal of total suspended solids (TSS) according to Table 3.6.

For water quality controls being used in series the method to calculate their TSS removal rate is provided in Chapter 5.

Recommended Stormwater Control Practices

Below is a list of recommended structural stormwater control practices. These structural controls are recommended for use in a wide variety of applications and have differing abilities to remove various kinds of pollutants. It may take more than one control to achieve a certain pollution reduction level. A detailed discussion of each of the controls, as well as design criteria and procedures, can be found in the [Site Development Controls Technical Manual](#). Refer to Table 3.6 for details regarding primary and secondary controls.

- Bioretention
- Enhanced swales (dry, wet, wetland)
- Alum treatment
- Detention
- Filter strips
- Sand filters, filter boxes, etc
- Infiltration wells and trenches
- Ponds
- Porous surfaces
- Proprietary systems
- Green roofs
- Rainwater harvesting
- Wetlands
- Submerged gravel wetlands

Local Provisions:

Allowed site development controls for the City of Hurst include the following:

Bioretention ponds, enhanced swales, detention, filter strips, planter boxes, infiltration wells and trenches, ponds, wetlands, and rainwater harvesting.

The use of other equivalent site development controls or proprietary controls will require written approval and will be at the discretion of the Public Works Director or designee.

Using Other or New Structural Stormwater Controls

Innovative technologies will be allowed and encouraged. Any such system will be required to provide sufficient documentation as to its effectiveness and reliability. Communities can allow controls not included in this manual at their discretion. However, these communities shall require third party proof of performance, maintenance, application requirements, and limitations.

More specifically, new structural stormwater control designs will not be accepted for inclusion in the manual until independent performance data shows that the structural control conforms to local and/or State criteria for treatment, conveyance, maintenance, and environmental impact.

Suitability of Stormwater Controls to Meet Stormwater Management Goals

The stormwater control practices recommended in this manual vary in their applicability and ability to meet stormwater management goals:

Primary Controls

Primary Structural Stormwater Controls have the ability to fully address one or more of the Steps in the *integrated* Focus Areas if designed appropriately. Structural controls are recommended for use with a wide variety of land uses and development types. These structural controls have a demonstrated ability to effectively treat the Water Quality Volume (WQv) and have been shown to be able to remove 70% to 80% of the annual average total suspended solids (TSS) load in typical post-development urban runoff when designed, constructed, and maintained in accordance with recommended specifications. Several of these structural controls can also be designed to provide primary control for downstream streambank protection (SPv) and flood mitigation. These structural controls are recommended stormwater management facilities for a site wherever feasible and practical.

Secondary Controls

A number of structural controls are recommended only for limited use or for special site or design conditions. Generally, these practices either: (1) do not have the ability on their own to fully address one or more of the Steps in the *integrated* Focus Areas, (2) are intended to address hotspot or specific land use constraints or conditions, and/or (3) may have high or special maintenance requirements that may preclude their use. These types of structural controls are typically used for water quality treatment only. Some of these controls can be used as pretreatment measures or in series with other structural controls to meet pollutant removal goals. Such structural controls are not recommended for residential developments.

Table 3.6 summarizes the stormwater management suitability of the various stormwater controls in addressing the *integrated* Focus Areas. The *Site Development Controls Technical Manual* provides guidance on the use of stormwater controls as well as how to calculate the pollutant removal efficiency for stormwater controls in series. The *Site Development Controls Technical Manual* also provides guidance for choosing the appropriate stormwater control(s) for a site as well as the basic considerations and limitations on the use of a particular stormwater control.

Category	<i>integrated</i> Stormwater Controls	TSS/ Sediment Removal Rate	Water Quality Protection	Streambank Protection	On-Site Flood Control	Downstream Flood Control
Bioretention Areas	Bioretention Areas	80%	P	S	S	-
Channels	Enhanced Swales	80%	P	S	S	S
	Channels, Grass	50%	S	S	P	S
	Channels, Open	-	-	-	P	S
Chemical Treatment	Alum Treatment System	90%	P	-	-	-
Conveyance System Components	Culverts	-	-	-	P	P
	Energy Dissipation	-	-	P	S	S
	Inlets/Street Gutters	-	-	-	P	-
	Pipe Systems	-	-	P	P	P
Detention	Detention, Dry	65%	S	P	P	P
	Detention, Extended Dry	65%	S	P	P	P
	Detention, Multi-purpose Areas	-	-	P	P	P
	Detention, Underground	-	-	P	P	P
Filtration	Filter Strips	50%	S	-	-	-
	Organic Filters	80%	P	-	-	-
	Planter Boxes	80%	P	-	-	-
	Sand Filters, Surface/Perimeter	80%	P	S	-	-
	Sand Filters, Underground	80%	P	-	-	-
Hydrodynamic Devices	Gravity (Oil-Grit) Separator	40%	S	-	-	-
Infiltration	Downspout Drywell	80%	P	-	-	-
	Infiltration Trenches	80%	P	S	-	-
	Soakage Trenches	80%	P	S	-	-
Ponds	Wet Pond	80%	P	P	P	P
	Wet ED Pond	80%	P	P	P	P
	Micropool ED Pond	80%	P	P	P	P
	Multiple Ponds	80%	P	P	P	P
Porous Surfaces	Green Roof	85%	P	S	-	-
	Modular Porous Paver Systems	²	S	S	-	-
	Porous Concrete	²	S	S	-	-
Proprietary Systems	Proprietary Systems ¹	¹	S/P	S	S	S
Re-Use	Rain Barrels	-	P	-	-	-
Wetlands	Wetlands, Stormwater	80%	P	P	P	P
	Wetlands, Submerged Gravel	80%	P	P	S	-

P = Primary Control: Able to meet design criterion if properly designed, constructed and maintained.

S = Secondary Control: May partially meet design criteria. Designated as a Secondary control due to considerations such as maintenance concerns. For Water Quality Protection, recommended for limited use in approved community-designated areas.

- = Not typically used or able to meet design criterion.
- ¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data, if used as a primary control. Third-party sources could include Technology Acceptance Reciprocity Partnership, Technology Assessment Protocol – Ecology, or others.
- ² = Porous surfaces provide water quality benefits by reducing the effective impervious area.

3.2.4 Option 3: Assist with Off-Site Pollution Prevention Programs and Activities

Some communities have implemented pollution prevention programs/activities in certain areas to remove pollutants from the runoff after it has been discharged from the site. This may be especially true in intensely urbanized areas facing site redevelopment where many of the BMP criteria would be difficult to apply. These programs will be identified in the local jurisdiction's approved TPDES stormwater permit and/or in a municipality's approved watershed plan. In lieu of on-site treatment, the developer can request to simply assist with the implementation of these off-site pollution prevention programs/activities.

Developers should contact the municipality to determine if there are any plans to address runoff pollutants within the region of proposed development. If no plans exist, consider proposing regional alternatives that would address pollution prevention.

Local Provisions:

The City will consider plans for multiple sites to participate in a collective water quality plan. Requirements will be the same as those described in Options 1 and 2. By allowing multiple sites to produce a collective water quality plan options are increased in terms of placement of stormwater controls and site design practices.

3.3 Acceptable Downstream Conditions

As part of the iSWM Plan development, the downstream impacts of development must be carefully evaluated for the two focus areas of Streambank Protection and Flood Mitigation. The purpose of the downstream assessment is to protect downstream properties from increased flooding and downstream channels from increased erosion potential due to upstream development. The importance of the downstream assessment is particularly evident for larger sites or developments that have the potential to dramatically impact downstream areas. The cumulative effect of smaller sites, however, can be just as dramatic and, as such, following the *integrated* Focus Areas is just as important for the smaller sites as it is for the larger sites.

The assessment shall extend from the outfall of a proposed development to a point downstream where the discharge from a proposed development no longer has a significant impact, in terms of flooding increase or velocity above allowable, on the receiving stream or storm drainage system. The local jurisdiction shall be consulted to obtain records and maps related to the National Flood Insurance Program and the availability of Flood Insurance Studies and Flood Insurance Rate Maps (FIRMs) which will be helpful in this assessment. The assessment shall be a part of the preliminary and final iSWM plans, and must include the following properties:

- Hydrologic analysis of the pre- and post-development on-site conditions
- Drainage path that defines extent of the analysis
- Capacity analysis of all existing constraint points along the drainage path, such as existing floodplain developments, underground storm drainage systems culverts, bridges, tributary confluences, or channels
- Offsite undeveloped areas are considered as “full build-out” for both the pre- and post-development analyses

- Evaluation of peak discharges and velocities for three 24-hour storm events
 - Streambank protection storm
 - Conveyance storm
 - Flood mitigation storm
- Separate analysis for each major outfall from the proposed development

Once the analysis is complete, the designer must answer the following three questions at each determined junction downstream:

- Are the post-development discharges greater than the pre-development discharges?
- Are the post-development velocities greater than the pre-development velocities?
- Are the post-development velocities greater than the velocities allowed for the receiving system?
- Are the post-development flood heights more than 0.1 feet above the pre-development flood heights?

These questions shall be answered for each of the three storm events. The answers to these questions will determine the necessity, type, and size of non-structural and structural controls to be placed on-site or downstream of the proposed development.

Section 2.0 of the Hydrology Technical Manual gives additional guidance on calculating the discharges and velocities, as well as determining the downstream extent of the assessment.

Local Provisions:

Downstream Assessments are required for all developments applicable to this manual. The City of Hurst has hydrologic models for each watershed within the city limits. It is required that these models be updated based on proposed conditions and that the results show no adverse impacts downstream. Steps to perform a downstream assessment are provided in Section 2.0 of the Hydrology Technical Manual. City models are available from the Public Works Director or designee.

All three storm events (1-, 10-, and 100-yr) shall be analyzed in a downstream assessment.

3.4 Streambank Protection

The second focus area is in streambank protection. There are three options by which a developer can provide adequate streambank protection downstream of a proposed development. The first step is to perform the required downstream assessment as described in Section 3.3. If it is determined that the proposed project does not exceed acceptable downstream velocities or the downstream conditions are improved to adequately handle the increased velocity, then no additional streambank protection is required. If on-site or downstream improvements are required for streambank protection, easements or right-of-entry agreements will need to be obtained in accordance with Section 3.7. If the downstream assessment shows that the velocities are within acceptable limits, then no streambank protection is required. Acceptable limits for velocity control are contained in Tables 3.10 and 3.11.

Option 1: Reinforce/Stabilize Downstream Conditions

If the increased velocities are greater than the allowable velocity of the downstream receiving system, then the developer must reinforce/stabilize the downstream conveyance system. The proposed modifications must be designed so that the downstream system is protected from the post-development velocities. The developer must provide supporting calculations and/or documentation that the downstream velocities do not exceed the allowable range once the downstream modifications are installed.

Allowable bank protection methods include stone riprap, gabions, and bio-engineered methods. *Sections 3.2 and 4.0 of the Hydraulics Technical Manual* give design guidance for designing stone riprap for open

channels, culvert outfall protection, riprap aprons for erosion protection at outfalls, and riprap basins for energy dissipation.

Local Provisions:

The City of Hurst requires a report that shows there will be no adverse impacts downstream of a project location.

Option 2: Install Stormwater Controls to Maintain Existing Downstream Conditions

The developer must use on-site controls to keep downstream post-development discharges at or below allowable velocity limits. The developer must provide supporting calculations and/or documentation that the on-site controls will be designed such that downstream velocities for the three storm events (Streambank Protection, Conveyance, and Flood Mitigation) are within an allowable range once the controls are installed.

Local Provisions:

The City of Hurst requires a report that shows there will be no adverse impacts downstream of a project location.

Option 3: Control the Release of the 1-yr, 24-hour Storm Event

Twenty-four hours of extended detention shall be provided for on-site, post-developed runoff generated by the 1-year, 24-hour rainfall event to protect downstream channels. The required volume for extended detention is referred to as the Streambank Protection Volume (denoted SP_v). The reduction in the frequency and duration of bankfull flows through the controlled release provided by extended detention of the SP_v will reduce the bank scour rate and severity.

To determine the SP_v refer to *Section 3.0 of the Hydrology Technical Manual*.

Local Provisions:

The City of Hurst requires a report that shows there will be no adverse impacts downstream of a project location.

3.5 Flood Mitigation

3.5.1 Introduction

Flood analysis is based on the design storm events as defined in Section 1.3: for conveyance storm and the flood mitigation storm.

The intent of the flood mitigation criteria is to provide for public safety; minimize on-site and downstream flood impacts from the three storm events; maintain the boundaries of the mapped 100-year floodplain; and protect the physical integrity of the on-site stormwater controls and the downstream stormwater and flood mitigation facilities.

Flood mitigation must be provided for on-site conveyance system, as well as downstream outfalls as described in the following sections.

3.5.2 Flood Mitigation Design Options

There are three options by which a developer may address downstream flood mitigation. These options closely follow the three options for Streambank Protection. When on-site or downstream modifications are required for downstream flood mitigation, easements or right-of-entry agreements will need to be obtained in accordance with Section 3.7.

The developer will provide all supporting calculations and/or documentation to show that the existing downstream conveyance system has capacity (Q_c) to safely pass the full build-out flood mitigation storm discharge.

Option 1: Provide Adequate Downstream Conveyance Systems

When the downstream receiving system does not have adequate capacity, then the developer shall provide modifications to the off-site, downstream conveyance system. If this option is chosen the proposed modifications must be designed to adequately convey the full build-out stormwater peak discharges for the three storm events. The modifications must also extend to the point at which the discharge from the proposed development no longer has a significant impact on the receiving stream or storm drainage system. The developer must provide supporting calculations and/or documentation that the downstream peak discharges and water surface elevations are safely conveyed by the proposed system, without endangering downstream properties, structures, bridges, roadways, or other facilities.

Option 2: Install Stormwater Controls to Maintain Existing Downstream Conditions

When the downstream receiving system does not have adequate capacity, then the developer shall provide stormwater controls to reduce downstream flood impacts. These controls include on-site controls such as detention, regional controls, and, as a last resort, local flood protection such as levees, floodwalls, floodproofing, etc.

The developer must provide supporting calculations and/or documentation that the controls will be designed and constructed so that there is no increase in downstream peak discharges or water surface elevations due to development.

Option 3: In lieu of a Downstream Assessment, Maintain Existing On-Site Runoff Conditions

Lastly with Option 3, on-site controls shall be used to maintain the pre-development peak discharges from the site. The developer must provide supporting calculations and/or documentation that the on-site controls will be designed and constructed to maintain on-site existing conditions.

It is important to note that Option 3 does not require a downstream assessment. It is a detention-based approach to addressing downstream flood mitigation after the application of the *integrated* site design practices.

For many developments however, the results of a downstream assessment may show that significantly less flood mitigation is required than “detaining to pre-development conditions”. This method may also exacerbate downstream flooding problems due to timing of flows. The developer shall confirm that detention does not exacerbate peak flows in downstream reaches.

3.6 Stormwater Conveyance Systems

3.6.1 Introduction

Stormwater system design is an integral component of both site and overall stormwater management design. Good drainage design must strive to maintain compatibility and minimize interference with existing drainage patterns; control flooding of property, structures, and roadways for design flood events; and minimize potential environmental impacts on stormwater runoff.

Stormwater collection systems must be designed to provide adequate surface drainage while at the same time meeting other stormwater management goals such as water quality, streambank protection, habitat protection, and flood mitigation.

Design

Fully developed watershed conditions shall be used for determining runoff for the conveyance storm and the flood mitigation storm.

Local Provisions:

No local provisions added.

3.6.2 Hydraulic Design Criteria for Streets and Closed Conduits

Introduction

This section is intended to provide criteria and guidance for the design of on-site flood mitigation system components including:

- Street and roadway gutters
- Stormwater inlets
- Parking lot sheet flow
- Storm drain pipe systems

Streets and Stormwater Inlets

Design Frequency

- | | |
|--|---|
| <ul style="list-style-type: none"> • Streets and roadway gutters: conveyance storm event • Inlets on-grade: conveyance storm event • Parking lots: conveyance storm event • Storm drain pipe systems: conveyance storm event | <ul style="list-style-type: none"> • Low points: flood mitigation storm event • Street ROW: flood mitigation storm event • Drainage and Floodplain easements: flood mitigation storm event |
|--|---|

Local Provisions:

The City of Hurst uses the following design frequencies:

- For storm sewer pipes 27" or smaller the design frequency shall be the Conveyance (10yr) storm.
 - The right-of-way must contain the Flood Mitigation (100yr) storm energy grade line.
 - Positive overflow must be routed to convey storm flow not captured in the Flood Mitigation (100yr) storm.
- Larger pipe systems will be designed to the Flood Mitigation (100yr) storm.

Design Criteria*Streets and ROW*

Depth in the street shall not exceed top of curb or maximum flow spread limits for the conveyance storm. The flood mitigation storm shall be contained within the right-of-ways or easements.

Parking Lots

Parking lots shall be designed for the conveyance storm not to exceed top of curb with maximum ponding at low points of one (1) foot. The flood mitigation storm shall be contained on-site or within dedicated easements.

Flow Spread Limits

Inlets shall be spaced so that the spread of flow in the street for the conveyance storm shall not exceed the guidelines listed below, as measured from the gutter or face of the curb:

Street Classification	Allowable Encroachment
Collectors, Arterial, and Thoroughfares (greater than 2-lanes)	8 feet or one travel lane, both sides for a divided roadway
Residential Streets	curb depth or maximum 6 inches at gutter

Local Provisions:

The City of Hurst uses the following design criteria for spread limits:

- Inlets shall be spaced to allow a curb depth of no more than 5 inches.
- Finished floor elevations shall be set a minimum of 1 foot plus 2% from curb to structure above the top of curb at the centerline of the lot or 1 foot above the Flood Mitigation (100yr) storm water surface elevation, whichever is higher.

Storm Drain Pipe DesignDesign Frequency

- Pipe Design: conveyance storm event within pipe with hydraulic grade line (HGL) below throat of inlets
- ROW and Easements: flood mitigation storm event must be contained within the ROW or easement

Local Provisions:

The City of Hurst uses the following design frequencies:

- For storm sewer pipes 27" or smaller the design frequency shall be the Conveyance (10yr) storm.
 - The right-of-way must contain the Flood Mitigation (100yr) storm energy grade line.
 - Positive overflow must be routed to convey storm flow not captured in the Flood Mitigation (100yr) storm.
- Larger pipe systems will be designed to the Flood Mitigation (100yr) storm.

Design Criteria

- For ordinary conditions, storm drain pipes shall be sized on the assumption that they will flow full or practically full under the design discharge but will not be placed under pressure head. The Manning Formula is recommended for capacity calculations.
- The maximum hydraulic gradient shall not produce a velocity that exceeds 15 feet per second (fps). Table 3.8 shows the desirable velocities for most storm drainage design. Storm drains shall be designed to have a minimum mean velocity flowing full at 2.5 fps.

Description	Maximum Desirable Velocity
Culverts (All types)	15 fps
Storm Drains (Inlet laterals)	No Limit
Storm Drains (Collectors)	15 fps
Storm Drains (Mains)	12 fps

- The minimum desirable physical slope shall be 0.5% or the slope that will produce a velocity of 2.5 feet per second when the storm sewer is flowing full, whichever is greater.
- If the potential water surface elevation exceeds 1 foot below ground elevation for the design flow, the top of the pipe, or the gutter flow line, whichever is lowest, adjustments are needed in the system to reduce the elevation of the hydraulic grade line.
- Access manholes are required at intermediate points along straight runs of closed conduits. Table 3.9 gives maximum spacing criteria.

Pipe Size (inches)	Maximum Spacing (feet)
12-24	300
27-36	400
42-54	500
60 and up	1000

Local Provisions:

The City of Hurst using the following criteria in addition to the design criteria listed above:

- Minimum pipe size shall be 18 inches.
- The junction of different diameter pipes shall be made with prefabricated fittings so that the crowns of the pipes are at the same elevation.
- Manhole access shall be provided every 400 feet, superseding the criteria in Table 3.9.
- Minimum velocity requirements will be based on 1-year storm event flows.
- An example of storm drain line designations and callouts is shown in Chapter 5.
- When discharging into a creek or channel, the starting hydraulic gradeline (HGL) shall be the top of pipe or the water surface elevation of the coincidental peaking storm based on the Hydraulic Technical Manual Table 1.10, whichever is higher.

3.6.3 Hydraulic Design Criteria for Structures

Introduction

This section is intended to provide design criteria and guidance on several on-site flood mitigation system components, including culverts, bridges, vegetated and lined open channels, storage design, outlet structures, and energy dissipation devices for outlet protection.

Open Channels

Design Frequency

- Open channels, including all natural or structural channels, swales, and ditches shall be designed for the flood mitigation storm event
- Channels shall be designed with multiple stages. A low flow channel section containing the streambank protection flows and a high flow section that contains the conveyance and flood mitigation storms will improve stability and better mimic natural channel dimensions.

Local Provisions:

The City of Hurst uses the following design frequencies in addition to the criteria listed above:

- Stormwater runoff may be transported in open channels when the calculated pipe size for a storm drain system exceeds 72 inches in diameter or equivalent size.

Design Criteria

- Trapezoidal channels shall have a minimum channel bottom width of 6 feet.
- Channels with bottom widths greater than 6 feet shall be designed with a minimum bottom cross slope of 12 to 1 or with compound cross sections.
- Channel side slopes shall be stable throughout the entire length and the side slope shall depend on the channel material. Channel side slopes and roadside ditches with a side slope steeper than 3:1 shall require detailed geotechnical and slope stability analysis to justify slopes steeper than 3:1. However, any slope that is less than 3:1 needs a detailed analysis to prove that it can be done.
- Trapezoidal or parabolic cross sections are preferred over triangular shapes.

- For vegetative channels, design stability shall be determined using low vegetative retardance conditions (Class D). For design capacity, higher vegetative retardance conditions (Class C) shall be used.
- For vegetative channels, flow velocities within the channel shall not exceed the maximum permissible velocities given in Tables 3.10 and 3.11.
- If relocation of a stream channel is unavoidable, the cross-sectional shape, meander, pattern, roughness, sediment transport, and slope shall conform to the existing conditions insofar as practicable. Energy dissipation will be necessary when existing conditions cannot be duplicated.
- Streambank stabilization shall be provided, when appropriate, as a result of any stream disturbance such as encroachment and shall include both upstream and downstream banks as well as the local site.
- HEC-RAS, or similarly capable software approved by the entity with jurisdiction, shall be used to confirm the water surface profiles in open channels.
- The final design of artificial open channels shall be consistent with the velocity limitations for the selected channel lining. Maximum velocity values for selected lining categories are presented in Table 3.10. Seeding and mulch shall only be used when the design value does not exceed the allowable value for bare soil. Velocity limitations for vegetative linings are reported in Table 3.11. Vegetative lining calculations and stone riprap procedures are presented in Section 3.2 of the Hydraulics Technical Manual.
- For gabions, design velocities range from 10 fps for 6-inch mattresses up to 15 fps for 1-foot mattresses. Some manufacturers indicate that velocities of 20 fps are allowable for basket installations. The design of stable rock riprap lining depends on the intersection of the velocity (local boundary shear) and the size and gradation of the riprap material. More information on calculating acceptable riprap velocity limits is available in Section 3.2.7 of the Hydraulics Technical Manual.

Local Provisions:

Additional and revised criteria are listed below:

- Channels shall be designed with a 1 foot freeboard.
- Maximum earth slopes for unlined or partially lined channels shall not exceed 4:1 unless a detailed analysis is provided that proves steeper slopes will not cause negative impacts and written approval is given by the Public Works Director or designee.
- Maximum side slopes for lined portions of a channel shall not exceed 2:1 unless a detailed analysis is provided that proves steeper slopes will not cause negative impacts and written approval is given by the Public Works Director or designee.
- Unlined channels will be permitted only in areas designated by the Public Works Director or designee.
- The Manning's n value for unlined channels shall be based on expected conditions 1-year from installation.
- In addition to HEC-RAS, other FEMA approved software's will be allowed to confirm water surface profiles.

Table 3.10 Roughness Coefficients (Manning's n) and Allowable Velocities for Natural Channels		
Channel Description	Manning's n	Max. Permissible Channel Velocity (ft/s)
MINOR NATURAL STREAMS		
Fairly regular section		
1. Some grass and weeds, little or no brush	0.030	3 to 6
2. Dense growth of weeds, depth of flow materially greater than weed height	0.035	3 to 6
3. Some weeds, light brush on banks	0.035	3 to 6
4. Some weeds, heavy brush on banks	0.050	3 to 6
5. Some weeds, dense willows on banks	0.060	3 to 6
For trees within channels with branches submerged at high stage, increase above values by	0.010	
Irregular section with pools, slight channel meander, increase above values by	0.010	
Floodplain – Pasture		
1. Short grass	0.030	3 to 6
2. Tall grass	0.035	3 to 6
Floodplain – Cultivated Areas		
1. No crop	0.030	3 to 6
2. Mature row crops	0.035	3 to 6
3. Mature field crops	0.040	3 to 6
Floodplain – Uncleared		
1. Heavy weeds scattered brush	0.050	3 to 6
2. Wooded	0.120	3 to 6
MAJOR NATURAL STREAMS		
Roughness coefficient is usually less than for minor streams of similar description on account of less effective resistance offered by irregular banks or vegetation on banks. Values of "n" for larger streams of mostly regular sections, with no boulders or brush	Range from 0.028 to 0.060	3 to 6
UNLINED VEGETATED CHANNELS		
Clays (Bermuda Grass)	0.035	5 to 6
Sandy and Silty Soils (Bermuda Grass)	0.035	3 to 5
UNLINED NON-VEGETATED CHANNELS		
Sandy Soils	0.030	1.5 to 2.5
Silts	0.030	0.7 to 1.5
Sandy Silts	0.030	2.5 to 3.0
Clays	0.030	3.0 to 5.0
Coarse Gravels	0.030	5.0 to 6.0
Shale	0.030	6.0 to 10.0
Rock	0.025	15
For natural channels with specific vegetation type, refer to Table 3.11 for more detailed velocity control.		

Vegetation Type	Slope Range (%)¹	Maximum Velocity² (ft/s)
Bermuda grass	0-5	6
Bahia		4
Tall fescue grass mixtures ³	0-10	4
Kentucky bluegrass	0-5	6
Buffalo grass	5-10 >10	5 4
Grass mixture	0-5 ¹ 5-10	4 3
Sericea lespedeza, Weeping lovegrass, Alfalfa	0-5 ⁴	3
Annuals ⁵	0-5	3
Sod		4
Lapped sod		5
¹ Do not use on slopes steeper than 10% except for side-slope in combination channel. ² Use velocities exceeding 5 ft/s only where good stands can be maintained. ³ Mixtures of Tall Fescue, Bahia, and/or Bermuda ⁴ Do not use on slopes steeper than 5% except for side-slope in combination channel. ⁵ Annuals - used on mild slopes or as temporary protection until permanent covers are established.		

Source: Manual for Erosion and Sediment Control in Georgia, 1996.

Vegetative Design

- A two-part procedure is required for final design of temporary and vegetative channel linings.
 - Part 1, the design stability component, involves determining channel dimensions for low vegetative retardance conditions, using Class D as defined in Table 3.12.
 - Part 2, the design capacity component, involves determining the depth increase necessary to maintain capacity for higher vegetative retardance conditions, using Class C as defined in Table 3.12.
- If temporary lining is to be used during construction, vegetative retardance Class E shall be used for the design stability calculations.
- If the channel slope exceeds 10%, or a combination of channel linings will be used, additional procedures not presented below are required. References include HEC-15 (USDOT, FHWA, 1986) and HEC-14 (USDOT, FHWA, 1983).

Local Provisions:

No local provisions added.

Retardance Class	Cover	Condition
A	Weeping Lovegrass	Excellent stand, tall (average 30")
	Yellow Bluestem Ischaemum	Excellent stand, tall (average 36")
B	Kudzu	Very dense growth, uncut
	Bermuda grass	Good stand, tall (average 12")
	Native grass mixture Little bluestem, bluestem, blue gamma other short and long stem Midwest grasses	Good stand, unmowed
	Weeping lovegrass	Good stand, tall (average 24")
	Laspedeza sericea	Good stand, not woody, tall (average 19")
	Alfalfa	Good stand, uncut (average 11")
	Weeping lovegrass	Good stand, unmowed (average 13")
C	Kudzu	Dense growth, uncut
	Blue gamma	Good stand, uncut (average 13")
	Crabgrass	Fair stand, uncut (10 – 48")
	Bermuda grass	Good stand, mowed (average 6")
	Common lespedeza	Good stand, uncut (average 11")
	Grass-legume mixture: summer (orchard grass redtop, Italian ryegrass, and common lespedeza)	Good stand, uncut (6 – 8 ")
D	Centipede grass	Very dense cover (average 6")
	Kentucky bluegrass	Good stand, headed (6 – 12")
	Bermuda grass	Good stand, cut to 2.5"
	Common lespedeza	Excellent stand, uncut (average 4.5")
	Buffalo grass	Good stand, uncut (3 – 6")
E	Grass-legume mixture: fall, spring (orchard grass, redtop, Italian ryegrass, and common lespedeza)	Good stand, uncut (4 – 5")
	Lespedeza serices	After cutting to 2" (very good before cutting)
E	Bermuda grass	Good stand, cut to 1.5"
	Bermuda grass	Burned stubble

Note: Covers classified have been tested in experimental channels. Covers were green and generally uniform.
Source: HEC-15, 1988.

Culverts

Culverts are cross drainage facilities that transport runoff under roadways or other improved areas.

Design Frequency

- Culverts shall be designed for the flood mitigation storm or in accordance with TxDOT requirements, whichever is more stringent. Consideration when designing culverts includes: roadway type, tailwater or depth of flow, structures, and property subject to flooding, emergency access, and road replacement costs.
- The flood mitigation storm shall be routed through all culverts to be sure building structures (e.g., houses, commercial buildings) are not flooded or increased damage does not occur to the highway or adjacent property for this design event.

Local Provisions:

No local provisions added.

Design Criteria

Velocity Limitations

- The maximum velocity shall be consistent with channel stability requirements at the culvert outlet.
- The maximum allowable velocity for corrugated metal pipe is 15 feet per second. There is no specified maximum allowable velocity for reinforced concrete pipe, but outlet protection shall be provided where discharge velocities will cause erosion conditions.
- To ensure self-cleaning during partial depth flow, a minimum velocity of 2.5 feet per second is required for the streambank protection storm when the culvert is flowing partially full.

Length and Slope

- The maximum slope using concrete pipe is 10% and for CMP is 14% before pipe-restraining methods must be taken.
- Maximum vertical distance from throat of intake to flowline in a drainage structure is 10 feet.
- Drops greater than 4 feet will require additional structural design.

Headwater Limitations

- The *allowable headwater* is the depth of water that can be ponded at the upstream end of the culvert during the design flood, which will be limited by one or more of the following constraints or conditions:
- Headwater will be non-damaging to upstream property.
- Culvert headwater plus 12 inches of freeboard shall not exceed top of curb or pavement for low point of road over culvert, whichever is lower.
- Ponding depth will be no greater than the elevation where flow diverts around the culvert.
- Elevations will be established to delineate floodplain zoning.
- The headwater shall be checked for the flood mitigation storm elevation to ensure compliance with flood plain management criteria and the culvert shall be sized to maintain flood-free conditions on major thoroughfares with 12-inch freeboard at the low-point of the road.
- Either the headwater shall be set to produce acceptable velocities or stabilization/energy dissipation shall be provided where these velocities are exceeded.
- In general, the constraint that gives the lowest allowable headwater elevation establishes the criteria for the hydraulic calculations.

Tailwater Considerations

- If the culvert outlet is operating with a free outfall, the critical depth and equivalent hydraulic grade line shall be determined.
- For culverts that discharge to an open channel, the stage-discharge curve for the channel must be determined. See *Section 2.1.4 of the Hydraulics Technical Manual* on methods to determine a stage-discharge curve.
- If an upstream culvert outlet is located near a downstream culvert inlet, the headwater elevation of the downstream culvert will establish the design tailwater depth for the upstream culvert.
- If the culvert discharges to a lake, pond, or other major water body, the expected high water elevation of the particular water body will establish the culvert tailwater.

Other Criteria

- In designing debris control structures, the Hydraulic Engineering Circular No. 9 entitled Debris Control Structures or other approved reference is required to be used.
- If storage is being assumed or will occur upstream of the culvert, refer to Section 2.0 of the Hydraulics Technical Manual regarding storage routing as part of the culvert design.
- Reinforced concrete pipe (RCP), pre-cast and cast in place concrete boxes are recommended for use (1) under a roadway, (2) when pipe slopes are less than 1%, or (3) for all flowing streams. RCP and fully coated corrugated metal pipe or high-density polyethylene (HDPE) pipe may also be used in open space areas.
- Culvert skews shall not exceed 45 degrees as measured from a line perpendicular to the roadway centerline without approval.
- The minimum allowable pipe diameter shall be 18 inches.
- Erosion, sediment control, and velocity dissipation shall be designed in accordance with Section 4.0 of the Hydraulics Technical Manual.

Local Provisions:

Additional or revised criteria are listed below:

Tailwater Considerations Updates:

- The tailwater for a culvert will be the highest elevation of the following:
 - Top of pipe at the outfall
 - The water surface elevation of the coincidental peaking storm as determined in the Hydraulic Technical Manual Table 1.10
 - Headwater of a downstream culvert inlet

Other Criteria Updates:

- Minimum pipe diameter shall be 18 inches unless otherwise authorized in writing by the Public Works Director or designee.
- Culverts shall be located in easements.
- Culverts shall provide a clear waterway having at least the same width as the downstream channel.
- Culverts shall have a clear height of 1 foot above the calculated upstream water depth for the Flood Mitigation (100yr) storm unless written approval is otherwise provided by the Public Works Director or designee.
- Culverts shall have upstream and downstream protection in the form of abutments, headwalls, or wingwalls.

Bridges

Bridges are cross drainage facilities with a span of 20 feet or larger.

Design Frequency

- Flood mitigation storm for all bridges

Local Provisions:

No local provisions added.

Design Criteria

- A freeboard of two feet shall be maintained between the computed design water surface and the low chord of all bridges.
- The contraction and expansion of water through the bridge opening creates hydraulic losses. These losses are accounted for through the use of loss coefficients. Table 3.13 gives recommended values for the Contraction (K_c) and Expansion (K_e) Coefficients.

Transition Type	Contraction (K_c)	Expansion (K_e)
No losses computed	0.0	0.0
Gradual transition	0.1	0.3
Typical bridge	0.3	0.5
Severe transition	0.6	0.8

Additional design guidance is located in [Section 3.4 of the Hydraulics Technical Manual](#).

Local Provisions:

Additional and revised criteria are listed below:

- Bridges shall have concrete lined bottoms and slopes unless otherwise authorized in writing by the Public Works Director or designee.
- If unlined, a scour analysis shall be performed on the bridge.
- Bridges shall have upstream and downstream protection in the form of abutments, headwalls, or wingwalls.
- Bridges shall follow the requirements of the floodplain regulations as stated in Chapter 9 of the City of Hurst Code of Ordinances.

Detention Structures

Design Frequency

- Detention structures shall be designed for the three storms (streambank protection, conveyance, and flood mitigation storms) for the critical storm duration that results in the maximum (or near maximum) peak flow.

Local Provisions:

No local provisions added.

Design Criteria

- Dry detention basins are sized to temporarily store the volume of runoff required to provide flood protection up to the flood mitigation storm, if required.
- Extended detention dry basins are sized to provide extended detention of the streambank protection volume over 24 hours and can also provide additional storage volume for normal detention (peak flow reduction) of the flood mitigation storm event.
- Routing calculations must be used to demonstrate that the storage volume and outlet structure configuration are adequate. See Section 2.0 of the Hydraulics Technical Manual for procedures on the design of detention storage.
- Detention Basins shall be designed with an 8 foot wide maintenance access.
- No earthen (grassed) embankment slopes shall exceed 4:1.
- A freeboard of 1 foot will be required for all detention ponds.
- A calculation summary shall be provided on construction plans. For detailed calculations of unit hydrograph studies, a separate report shall be provided to the municipality for review and referenced on the construction plans. Stage-storage-discharge values shall be tabulated and flow calculations for discharge structures shall be shown on the construction plans.
- An emergency spillway shall be provided at the flood mitigation maximum storage elevation with sufficient capacity to convey the flood mitigation storm assuming blockage of the outlet works with six inches of freeboard. Spillway requirements must also meet all appropriate state and Federal criteria.
- A landscape plan shall be provided for all detention ponds.
- All detention basins shall be stabilized against significant erosion and include a maintenance plan.
- Design calculations will be provided for all spillways and outlet structures.
- Maintenance agreements shall be included for all detention structures.
- Storage may be subject to the requirements of the Texas Dam Safety Program (see iSWM Program Guidance) based on the volume, dam height, and level of hazard.
- Earthen embankments 6 feet in height or greater shall be designed per Texas Commission on Environmental Quality guidelines for dam safety (see iSWM Program Guidance).
- Vegetated slopes shall be less than 20 feet in height and shall have side slopes no steeper than 2:1 (horizontal to vertical) although 3:1 is preferred. Riprap-protected slopes shall be no steeper than 2:1. Geotechnical slope stability analysis is recommended for slopes greater than 10 feet in height. Vegetated slopes with a side slope steeper than 2:1 shall require detailed geotechnical and slope stability analysis to justify slopes steeper than 2:1.
- Areas above the normal high water elevations of the detention facility should be sloped toward the basin to allow drainage and to prevent standing water. Careful finish grading is required to avoid

creation of upland surface depressions that may retain runoff. The bottom area of storage facilities should be graded toward the outlet to prevent standing water conditions. A low flow or pilot channel across the facility bottom from the inlet to the outlet (often constructed with riprap) is recommended to convey low flows and prevent standing water conditions.

Local Provisions:

Additional and revised criteria for detention basins are listed below:

- Detention basin side slopes shall not exceed 4:1 unless a detailed analysis is provided that proves steeper slopes will not cause negative impacts and written approval is given by the Public Works Director or designee.
- The minimum amount of storage volume of the detention basin shall be that volume required to reduce the runoff rate to a single-family rate.
- In addition to the 1 foot of freeboard, two feet of sedimentation storage shall be provided.
- Computer programs such as HEC-HMS are allowed for runoff hydrograph computation.
- Detention areas in parking lots shall not be:
 - In required parking spaces but in extra spaces.
 - Deeper than six inches unless warning signs are posted.
- Detention facilities shall be designed to empty in less than 48 hours, unless it is serving as an erosion control facility.
- Detention facilities shall not be counted as an erosion control facility unless:
 - The basins are designed to empty a minimum of 24 hours from the storm event AND
 - Adequate sediment storage areas in the basin have been set aside and are maintained.

Maintenance and Easement requirements.

- Drainage easements shall be provided for all regional detention/retention facilities and for other detention/retention facilities where two or more owners are involved.
- Detention/retention facilities shall be maintained by the owner unless the facilities and a drainage easement are dedicated to the City of Hurst. Typically, Hurst will not accept maintenance responsibilities of a detention/retention facility unless the bottom is concrete.
- A steel elevation rod shall be installed in all grass-bottomed detention/retention facilities. The owner will be responsible for removing the sediment when the two-foot storage is met.

Outlet Structures

Extended detention (ED) orifice sizing is required in design applications that provide extended detention for downstream streambank protection or the ED portion of the water quality protection volume. The release rate for both the WQ_v and SP_v shall discharge the ED volume in a period of 24 hours or longer. In both cases an extended detention orifice or reverse slope pipe must be used for the outlet. For a structural control facility providing both WQ_v extended detention and SP_v control (wet ED pond, micropool ED pond, and shallow ED wetland), there will be a need to design two outlet orifices – one for the water quality control outlet and one for the streambank protection drawdown.

Design Frequency

- Water quality storm
- Streambank protection storm
- Conveyance storm
- Flood mitigation storm

Local Provisions:

No local provisions added.

Design Criteria

- Estimate the required storage volumes for water quality protection, streambank protection, conveyance storm, and flood mitigation.
- Design extended detention outlets for each storm event.
- Outlet velocities shall be within the maximum allowable range based on channel material as shown in Tables 3.10 and 3.11.
- Design necessary outlet protection and energy dissipation facilities to avoid erosion problems downstream from outlet devices and emergency spillway(s).
- Perform buoyancy calculations for the outlet structure and footing. Flotation will occur when the weight of the structure is less than or equal to the buoyant force exerted by the water.

Additional design guidance is located in *Section 2.2 of the Hydraulics Technical Manual*.

Local Provisions:

No local provisions added.

Energy Dissipation

All drainage system outlets, whether for closed conduits, culverts, bridges, open channels, or storage facilities, shall provide energy dissipation to protect the receiving drainage element from erosion.

Design Frequency

- Conveyance storm
- Flood mitigation storm

Local Provisions:

Culverts and bridges shall have upstream and downstream protection in the form of abutments, headwalls, or wingwalls unless otherwise authorized in writing by the Public Works Director or designee.

Design Criteria

- *Energy dissipaters* are engineered devices such as rip-rap aprons or concrete baffles placed at the outlet of storm water conveyance systems for the purpose of reducing the velocity, energy and turbulence of the discharged flow.
- Erosion problems at culvert, pipe and engineered channel outlets are common. Determination of the flow conditions, scour potential, and channel erosion resistance shall be standard procedure for all designs.
- Energy dissipaters shall be employed whenever the velocity of flows leaving a stormwater management facility exceeds the erosion velocity of the downstream area channel system.

- Energy dissipater designs will vary based on discharge specifics and tailwater conditions.
- Outlet structures shall provide uniform redistribution or spreading of the flow without excessive separation and turbulence.
- Energy dissipaters are a required component of the iSWM Construction Plan.

Recommended Energy Dissipaters for outlet protection include the following:

- Riprap apron
- Riprap outlet basins
- Baffled outlets
- Grade Control Structures

The reader is referred to *Section 4.0 of the Hydraulics Technical Manual* and the Federal Highway Administration Hydraulic Engineering Circular No. 14 entitled, Hydraulic Design of Energy Dissipaters for Culverts and Channels, for the design procedures of other energy dissipaters.

Additional design guidance is located in *Section 4.0 of the Hydraulics Technical Manual*.

Local Provisions:

No local provisions added.

3.7 Easements, Plats, and Maintenance Agreements

Easements

Easements are required for all drainage systems that convey stormwater runoff across a development and must include sufficient area for operation and maintenance of the drainage system. Types of easements to be used include:

- Drainage easements - are required for both on-site and off-site public storm drains and for improved channels designed according to current municipality standards.
- Floodplain easements - shall be provided on-site along drainageways that are in a Special Flood Hazard Area as designated on the effective FEMA FIRM maps. No construction shall be allowed within a floodplain easement without the written approval of the municipality.
- Temporary drainage easements are required off-site for temporary channels when future off-site development is anticipated to be enclosed underground or follows an altered alignment. Temporary drainage easements will not be maintained by the municipality and will not terminate until permanent drainage improvements meeting municipality standards are installed and accepted. Temporary drainage easements will require written approval from the municipality.
- Drainage and utility easements can be combined for underground storm drains and channels, subject to adequate easement width as approved by the municipality.
- Drainage easements shall include adequate width for access and maintenance beyond the top of bank for improved channels.
- Retaining walls are not permitted within or adjacent to a drainage easement in a residential area in order to reduce the easement width. Retaining walls adjacent to the channel are allowed in non-residential areas only if the property owner provides an agreement for private maintenance.
- The minimum finished floor elevation for structures adjacent to a Special Flood Hazard Area shall be a minimum of one (1) foot above the fully-developed flood mitigation storm water surface elevation or two (2) feet above the effective FEMA base flood elevation.
- Improved channels shall have drainage easements dedicated to meet the requirements of the width of the channel, the one-foot freeboard, any perimeter fencing, and any underground tie-backs or anchors.
- Easements for detention ponds and permanent control BMPs shall be negotiated between the municipality and the property owner.
- The entire reach or each section of any drainage facility must be readily accessible to maintenance equipment. Additional easement(s) shall be required at the access point(s) and the access points shall be appropriately designed to restrict access by the public (including motorcycles).

Minimum easement width requirements for storm drain pipe are shown in Table 3.14 and shall be as follows:

- The outside face of the proposed storm drain line shall be placed five (5) feet off either edge of the storm drain easement. The proposed centerline of overflow swales shall normally coincide with the centerline of the easement.
- For pipe sizes up to 54", a minimum of five (5) additional feet shall be dedicated when shared with utilities.
- Box culvert minimum easement width shall be determined using Table 3.14 based on an equivalent box culvert width to pipe diameter.
- For parallel storm drain systems with a combined width greater than 8 feet the minimum easement shall be equal to the width of the parallel storm drain system plus twenty (20) additional feet.

- Drainage easements will generally extend at least twenty-five (25) feet past an outfall headwall to provide an area for maintenance operations. Drainage easements along a required outfall channel or ditch shall be provided until the flowline reaches an acceptable outfall. The minimum storm drain shall not be on property line, except where a variance has been granted.

Pipe Size	Minimum Easement Width Required
39" and under	15 Feet
42" through 54"	20 Feet
60" through 66"	25 Feet
72" through 102"	30 Feet

Local Provisions:

Additional or revised criteria for easements:

- The minimum finished floor elevation for structures shall be one (1) foot above the FEMA base flood elevation, nearest adjacent sanitary sewer manhole, or crown of adjacent street, whichever is greater.
- Lot grading shall be conducted in a manner in which will not allow runoff to cross more than 2 lots (including the lot on which the drainage originates) or 1 acre, whichever is greater. If this is not possible, then a drainage easement must be provided and any necessary facilities shall be constructed and installed by the developer.

Additional or revised criteria for PIPE easements:

- Minimum easement width requirements in Table 3.14 shall be based on listed pipe sizes or equivalent carrying sizes of box pipes.
- Pipes with large depths may require additional easement width.
- Easement width for storm sewer pipe shall not be less than 15 feet

Additional or revised criteria for CHANNEL easements:

- Easement width for open channels shall not be less than 40 feet wider than the top of the channel with 20 feet on each side to serve as access ways for maintenance purposes.
- Channels with associated floodplains must include the entire floodplain within an easement or the easement width equivalent to a 3:1 erosion control setback from the channel bottom, whichever is greater.

Additional or revised criteria for DETENTION/RETENTION easements:

- Drainage easements shall be provided for all regional detention/retention facilities and for other detention/retention facilities where two or more owners are involved.

Plats

All platting shall follow established development standards established by the local municipality. Plats shall include pertinent drainage information that will be filed with the plat. Elements to be included on the plat include:

- All public and private drainage easements not recorded by separate instrument
- Easements to be recorded by separate instrument shall be documented on the plat
- All floodplain easements

- Legal disclosure for drainage provisions upon sale or transfer of property
- Documentation of maintenance responsibilities and agreements including transfer of responsibility upon sale of the property

Local Provisions:

See the checklists provided in Chapter 5 for a detailed list of items to be included throughout the platting process.

Maintenance Agreements

All drainage improvements constructed within a development and any existing or natural drainage systems to remain in use shall require a maintenance agreement that identifies responsible parties for maintenance. Both private and public maintenance responsibility shall be negotiated between the municipality and the owner and documented in the agreement. The maintenance agreement shall be written such that it remains in force upon sale or transfer of the property.

Local Provisions:

Additional or revised maintenance requirements.

- Drainage improvements constructed and installed by private developers are the responsibility of the owner to operate and maintain.
- Maintenance records must be kept on site at all times and made available at the City's request.

Additional or revised DETENTION maintenance requirements.

- Detention/retention facilities shall be maintained by the owner unless the facilities and a drainage easement are dedicated to the City of Hurst. Typically, Hurst will not accept maintenance responsibilities of a detention/retention facility unless the bottom is concrete.
- A steel elevation rod shall be installed in all grass-bottomed detention/retention facilities. The owner will be responsible for removing the sediment when the two-foot storage is met.

3.8 Stormwater Control Selection

3.8.1 Control Screening Process

Outlined below is a screening process for structural stormwater controls that can effectively treat the water quality volume, as well as provide water quantity control. This process is intended to assist the site designer and design engineer in the selection of the most appropriate structural controls for a development site and to provide guidance on factors to consider in their location. This information is also contained in the *Site Development Controls Technical Manual*.

The following four criteria shall be evaluated in order to select the appropriate structural control(s) or group of controls for a development:

- Stormwater treatment suitability
- Water quality performance

- Site applicability
- Implementation considerations

In addition, the following factors shall be considered for a given site and any specific design criteria or restrictions need to be evaluated:

- Physiographic factors
- Soils
- Special watershed or stream considerations

Finally, environmental regulations shall be considered as they may influence the location of a structural control on site or may require a permit.

The following steps provide a selection process for comparing and evaluating various structural stormwater controls using a screening matrix and a list of location and permitting factors. These tools are provided to assist the design engineer in selecting the subset of structural controls that will meet the stormwater management and design objectives for a development site or project.

Step 1 Overall Applicability

The following are the details of the various screening categories and individual characteristics used to evaluate the structural controls.

Table 3.15 - Stormwater Management Suitability

The first category in the matrix examines the capability of each structural control option to provide water quality treatment, downstream streambank protection, and flood control. A blank entry means that the structural control cannot or is not typically used to meet an *integrated* Focus Area. This does not necessarily mean that it should be eliminated from consideration, but rather it is a reminder that more than one structural control may be needed at a site (e.g., a bioretention area used in conjunction with dry detention storage).

Ability to treat the Water Quality Volume (WQ_v): This indicates whether a structural control provides treatment of the water quality volume (WQ_v). The presence of “P” or “S” indicates whether the control is a Primary or Secondary control, respectively, for meeting the TSS reduction goal.

Ability to provide Streambank Protection (SP_v): This indicates whether the structural control can be used to provide the extended detention of the streambank protection volume (SP_v). The presence of a “P” indicates that the structural control can be used to meet SP_v requirements. An “S” indicates that the structural control may be sized to provide streambank protection in certain situations, for instance on small sites.

Ability to provide Flood Control (Q_f): This indicates whether a structural control can be used to meet the flood control criteria. The presence of a “P” indicates that the structural control can be used to provide peak reduction of the flood mitigation storm event.

Table 3.16 - Relative Water Quality Performance

The second category of the matrix provides an overview of the pollutant removal performance for each structural control option when designed, constructed, and maintained according to the criteria and specifications in this manual.

Ability to provide TSS and Sediment Removal: This column indicates the capability of a structural control to remove sediment in runoff. All of the Primary structural controls are presumed to remove 70% to 80% of the average annual TSS load in typical urban post-development runoff (and a proportional removal of other pollutants).

Ability to provide Nutrient Treatment: This column indicates the capability of a structural control to remove the nutrients nitrogen and phosphorus in runoff, which may be of particular concern with certain downstream receiving waters.

Ability to provide Bacteria Removal: This column indicates the capability of a structural control to remove bacteria in runoff. This capability may be of particular concern when meeting regulatory water quality criteria under the Total Maximum Daily Load (TMDL) program.

Ability to accept Hotspot Runoff: This last column indicates the capability of a structural control to treat runoff from designated hotspots. Hotspots are land uses or activities that produce higher concentrations of trace metals, hydrocarbons, or other priority pollutants. Examples of hotspots might include: gas stations, convenience stores, marinas, public works storage areas, garbage transfer facilities, material storage sites, vehicle service and maintenance areas, commercial nurseries, vehicle washing/steam cleaning, landfills, construction sites, industrial sites, industrial rooftops, and auto salvage or recycling facilities. A check mark indicates that the structural control may be used on hotspot site. However, it may have specific design restrictions. Please see the specific design criteria of the structural control for more details in the [Site Development Controls Technical Manual](#). Local jurisdictions may have other site uses that they designate as hotspots. Therefore, their criteria should be checked as well.

Table 3.17 - Site Applicability

The third category of the matrix provides an overview of the specific site conditions or criteria that must be met for a particular structural control to be suitable. In some cases, these values are recommended values or limits and can be exceeded or reduced with proper design or depending on specific circumstances. Please see the specific criteria section of the structural control for more details.

Drainage Area: This column indicates the approximate minimum or maximum drainage area considered suitable for the structural control practice. If the drainage area present at a site is slightly greater than the maximum allowable drainage area for a practice, some leeway can be permitted if more than one practice can be installed. The minimum drainage areas indicated for ponds and wetlands should not be considered inflexible limits and may be increased or decreased depending on water availability (baseflow or groundwater), the mechanisms employed to prevent outlet clogging, or design variations used to maintain a permanent pool (e.g., liners).

Space Required (Space Consumed): This comparative index expresses how much space a structural control typically consumes at a site in terms of the approximate area required as a percentage of the impervious area draining to the control.

Slope: This column evaluates the effect of slope on the structural control practice. Specifically, the slope restrictions refer to how flat the area where the facility is installed must be and/or how steep the contributing drainage area or flow length can be.

Minimum Head: This column provides an estimate of the minimum elevation difference needed at a site (from the inflow to the outflow) to allow for gravity operation within the structural control.

Water Table: This column indicates the minimum depth to the seasonally high water table from the bottom or floor of a structural control.

Table 3.18 - Implementation Considerations

The fourth category in the matrix provides additional considerations for the applicability of each structural control option.

Residential Subdivision Use: This column identifies whether or not a structural control is suitable for typical residential subdivision development (not including high-density or ultra-urban areas).

Ultra-Urban: This column identifies those structural controls appropriate for use in very high-density (ultra-urban) areas, or areas where space is a premium.

Construction Cost: The structural controls are ranked according to their relative construction cost per impervious acre treated, as determined from cost surveys.

Maintenance: This column assesses the relative maintenance effort needed for a structural stormwater control, in terms of three criteria: frequency of scheduled maintenance, chronic maintenance problems (such as clogging), and reported failure rates. It should be noted that **all structural controls** require routine inspection and maintenance.

Local Provisions:

Allowed site development controls for the City of Hurst include the following:

Bioretention ponds, enhanced swales, detention, filter strips, planter boxes, infiltration wells and trenches, ponds, wetlands, and rainwater harvesting.

The use of other equivalent site development controls or proprietary controls will require written approval and will be at the discretion of the Public Works Director or designee.

Table 3.15 Stormwater Treatment Suitability					
Category	integrated Stormwater Controls	Stormwater Treatment Suitability			
		Water Quality Protection	Streambank Protection	On-Site Flood Control	Downstream Flood Control
Bioretention Areas	Bioretention Areas	P	S	S	-
Channels	Enhanced Swales	P	S	S	S
	Channels, Grass	S	S	P	S
	Channels, Open	-	-	P	S
Chemical Treatment	Alum Treatment System	P	-	-	-
Conveyance System Components	Culverts	-	-	P	P
	Energy Dissipation	-	P	S	S
	Inlets/Street Gutters	-	-	P	-
	Pipe Systems	-	P	P	P
Detention	Detention, Dry	S	P	P	P
	Detention, Extended Dry	S	P	P	P
	Detention, Multi-purpose Areas	-	P	P	P
	Detention, Underground	-	P	P	P
Filtration	Filter Strips	S	-	-	-
	Organic Filters	P	-	-	-
	Planter Boxes	P	-	-	-
	Sand Filters, Surface/Perimeter	P	S	-	-
	Sand Filters, Underground	P	-	-	-
Hydrodynamic Devices	Gravity (Oil-Grit) Separator	S	-	-	-
Infiltration	Downspout Drywell	P	-	-	-
	Infiltration Trenches	P	S	-	-
	Soakage Trenches	P	S	-	-
Ponds	Wet Pond	P	P	P	P
	Wet ED Pond	P	P	P	P
	Micropool ED Pond	P	P	P	P
	Multiple Ponds	P	P	P	P
Porous Surfaces	Green Roof	P	S	-	-
	Modular Porous Paver Systems	S	S	-	-
	Porous Concrete	S	S	-	-
Proprietary Systems	Proprietary Systems ¹	S/P	S	S	S
Re-Use	Rain Barrels	P	-	-	-
Wetlands	Wetlands, Stormwater	P	P	P	P
	Wetlands, Submerged Gravel	P	P	S	-

P = Primary Control: Able to meet design criterion if properly designed, constructed and maintained.

S = Secondary Control: May partially meet design criteria. May be a Primary Control but designated as a Secondary due to other considerations. For Water Quality Protection, recommended for limited use in approved community-designated areas.

- = Not typically used or able to meet design criterion.

¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.

Table 3.16 Water Quality Performance

Category	integrated Stormwater Controls	Water Quality Performance			
		TSS/ Sediment Removal Rate	Nutrient Removal Rate (TP/TN)	Bacteria Removal Rate	Hotspot Application
Bioretention Areas	Bioretention Areas	80%	60%/50%	-	✓
Channels	Enhanced Swales	80%	25%/40%	-	✓
	Channels, Grass	50%	25%/20%	-	
	Channels, Open	-	-	-	
Chemical Treatment	Alum Treatment System	90%	80%/60%	90%	✓
Conveyance System Components	Culverts	-	-	-	
	Energy Dissipation	-	-	-	
	Inlets/Street Gutters	-	-	-	
	Pipe Systems	-	-	-	
Detention	Detention, Dry	65%	50%/30%	70%	✓
	Detention, Extended Dry	65%	50%/30%	70%	✓
	Detention, Multi-purpose Areas	-	-	-	
	Detention, Underground	-	-	-	
Filtration	Filter Strips	50%	20%/20%	-	
	Organic Filters	80%	60%/40%	50%	✓
	Planter Boxes	80%	60%/40%	-	
	Sand Filters, Surface/Perimeter	80%	50%/25%	40%	✓
	Sand Filters, Underground	80%	50%/25%	40%	✓
Hydrodynamic Devices	Gravity (Oil-Grit) Separator	40%	5%/5%	-	
Infiltration	Downspout Drywell	80%	60%/60%	90%	
	Infiltration Trenches	80%	60%/60%	90%	
	Soakage Trenches	80%	60%/60%	90%	
Ponds	Wet Pond	80%	50%/30%	70%	✓
	Wet ED Pond	80%	50%/30%	70%	✓
	Micropool ED Pond	80%	50%/30%	70%	✓
	Multiple Ponds	80%	50%/30%	70%	✓
Porous Surfaces	Green Roof	85%	95%/16%	-	✓
	Modular Porous Paver Systems	2	80%/80%	-	
	Porous Concrete	2	50%/65%	-	
Proprietary Systems	Proprietary Systems ¹	1	1	1	
Re-Use	Rain Barrels	-	-	-	
Wetlands	Wetlands, Stormwater	80%	40%/30%	70%	✓
	Wetlands, Submerged Gravel	80%	40%/30%	70%	✓

✓ = Meets suitability criteria

- = Not typically used or able to meet design criterion.

¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.² = Porous surfaces provide water quality benefits by reducing the effective impervious area.

Table 3.17 Site Applicability						
Category	Integrated Stormwater Controls	Site Applicability				
		Drainage Area (acres)	Space Req'd (% of Tributary imp. Area)	Site Slope	Minimum Head Required	Depth to Water Table
Bioretention Areas	Bioretention Areas	5 max ³	5-7%	6% max	5 ft	2 ft
Channels	Enhanced Swales	5 max	10-20%	4% max	1 ft	Below WT
	Channels, Grass					
	Channels, Open					
Chemical Treatment	Alum Treatment System	25 min	None			
Conveyance System Components	Culverts					
	Energy Dissipation					
	Inlets/Street Gutters					
	Pipe Systems					
Detention	Detention, Dry		2-3%	15% across pond	6 to 8 ft	2 ft
	Detention, Extended Dry		2-3%	15% across pond	6 to 8 ft	2 ft
	Detention, Multi-purpose Areas	200 max		1% for Parking Lot; 0.25 in/ft for Rooftop		
	Detention, Underground	200 max				
Filtration	Filter Strips	2 max ³	20-25%	2-6%		
	Organic Filters	10 max ³	2-3%		5 to 8 ft	
	Planter Boxes		6%			
	Sand Filters, Surface/Perimeter	10 max ³ / 2 max ³	2-3%	6% max	5 ft per 2-3 ft	2 ft
	Sand Filters, Underground	5 max	None			
Hydrodynamic Devices	Gravity (Oil-Grit) Separator	1 max ³	None			
Infiltration	Downspout Drywell					
	Infiltration Trenches	5 max	2-3%	6% max	1 ft	4 ft
	Soakage Trenches	5 max	27 ft per 1000 ft ² imp. area	6% max	1 ft	4 ft
Ponds	Wet Pond		2-3%	15% max	6 to 8 ft	2 ft, if hotspot or aquifer
	Wet ED Pond	25 min ³				
	Micropool ED Pond	10 min ³				
	Multiple Ponds	25 min ³				
Porous Surfaces	Green Roof					
	Modular Porous Paver Systems	5 max	Varies			
	Porous Concrete	5 max	Varies			
Proprietary Systems	Proprietary Systems ¹	1	1			
Re-Use	Rain Barrels					
Wetlands	Wetlands, Stormwater	25 min	3-5%	8% max	3 to 5 ft (shallow) 6 to 8 ft (pond)	2 ft, if hotspot or aquifer
	Wetlands, Submerged Gravel	5 min			2 to 3 ft	Below WT

- = Not typically used or able to meet design criterion.

¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.

² = Porous surfaces provide water quality benefits by reducing the effective impervious area.

³ = Drainage area can be larger in some instances

Category	Integrated Stormwater Controls	Implementation Considerations			
		Residential Subdivision Use	High Density/Ultra Urban	Capital Cost	Maintenance Burden
Bioretention Areas	Bioretention Areas	✓	✓	Moderate	Low
Channels	Enhanced Swales	✓		High	Low
	Channels, Grass	✓		Low	Moderate
	Channels, Open	✓		Low	Low
Chemical Treatment	Alum Treatment System	✓	✓	High	High
Conveyance System Components	Culverts	✓	✓	Low	Low
	Energy Dissipation	✓	✓	Low	Low
	Inlets/Street Gutters	✓	✓	Low	Low
	Pipe Systems	✓	✓	Low	Low
Detention	Detention, Dry	✓		Low	Moderate to High
	Detention, Extended Dry	✓		Low	Moderate to High
	Detention, Multi-purpose Areas	✓	✓	Low	Low
	Detention, Underground		✓	High	Moderate
Filtration	Filter Strips	✓		Low	Moderate
	Organic Filters		✓	High	High
	Planter Boxes		✓	Low	Moderate
	Sand Filters, Surface/Perimeter		✓	High	High
	Sand Filters, Underground		✓	High	High
Hydrodynamic Devices	Gravity (Oil-Grit) Separator		✓	High	High
Infiltration	Downspout Drywell	✓	✓	Low	Moderate
	Infiltration Trenches	✓	✓	High	High
	Soakage Trenches	✓	✓	High	High
Ponds	Wet Pond	✓		Low	Low
	Wet ED Pond	✓		Low	Low
	Micropool ED Pond	✓		Low	Moderate
	Multiple Ponds	✓		Low	Low
Porous Surfaces	Green Roof		✓	High	High
	Modular Porous Paver Systems		✓	Moderate	High
	Porous Concrete		✓	High	High
Proprietary Systems	Proprietary Systems ¹	1	✓	High	High
Re-Use	Rain Barrels	✓	✓	Low	High
Wetlands	Wetlands, Stormwater	✓		Moderate	Moderate
	Wetlands, Submerged Gravel	✓	✓	Moderate	High

✓ = Meets suitability criteria

- = Not typically used or able to meet design criterion.

1 = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.

Step 2 Specific Criteria

The last three categories in the Structural Control Screening matrix provide an overview of various specific design criteria and specifications, or exclusions for a structural control that may be present due to a site's general physiographic character, soils, or location in a watershed with special water resources considerations.

Table 3.19 - Physiographic Factors

Three key factors to consider are low-relief, high-relief, and karst terrain. In the North Central Texas, low relief (very flat) areas are primarily located east of the Dallas metropolitan area. High relief (steep and hilly) areas are primarily located west of the Fort Worth metropolitan area. Karst and major carbonaceous rock areas are limited to portions of Palo Pinto, Erath, Hood, Johnson, and Somervell counties. Special geotechnical testing requirements may be needed in karst areas. The local reviewing authority should be consulted to determine if a project is subject to terrain constraints.

- Low relief areas need special consideration because many structural controls require a hydraulic head to move stormwater runoff through the facility.
- High relief may limit the use of some structural controls that need flat or gently sloping areas to settle out sediment or to reduce velocities. In other cases, high relief may impact dam heights to the point that a structural control becomes infeasible.
- Karst terrain can limit the use of some structural controls as the infiltration of polluted waters directly into underground streams found in karst areas may be prohibited. In addition, ponding areas may not reliably hold water in karst areas.

Table 3.20 - Soils

The key evaluation factors are based on an initial investigation of the NRCS hydrologic soils groups at the site. Note that more detailed geotechnical tests are usually required for infiltration feasibility and during design to confirm permeability and other factors.

Table 3.21 - Special Watershed or Stream Considerations

The design of structural stormwater controls is fundamentally influenced by the nature of the downstream water body that will be receiving the stormwater discharge. In addition, the designer should consult with the appropriate review authority to determine if their development project is subject to additional structural control criteria as a result of an adopted local watershed plan or special provision.

In some cases, higher pollutant removal or environmental performance is needed to fully protect aquatic resources and/or human health and safety within a particular watershed or receiving water. Therefore, special design criteria for a particular structural control or the exclusion of one or more controls may need to be considered within these watersheds or areas. Examples of important watershed factors to consider include:

High Quality Streams (Streams with a watershed impervious cover less than approximately 15%). These streams may also possess high quality cool water or warm water aquatic resources or endangered species. The design objectives are to maintain habitat quality through the same techniques used for cold-water streams, with the exception that stream warming is not as severe of a design constraint. These streams may also be specially designated by local authorities.

Wellhead Protection: Areas that recharge existing public water supply wells present a unique management challenge. The key design constraint is to prevent possible groundwater contamination by preventing infiltration of hotspot runoff. At the same time, recharge of unpolluted stormwater is encouraged to maintain flow in streams and wells during dry weather.

Reservoir or Drinking Water Protection: Watersheds that deliver surface runoff to a public water supply reservoir or impoundment are a special concern. Depending on the available treatment, a greater level of pollutant removal may be necessary for the pollutants of concern, such as bacteria

pathogens, nutrients, sediment, or metals. One particular management concern for reservoirs is ensuring stormwater hotspots are adequately treated so they do not contaminate drinking water.

Local Provisions:

No local provisions added.

Category	Integrated Stormwater Controls	Physiographic Factors		
		Low Relief	High Relief	Karst
Bioretention Areas	Bioretention Areas	Several design variations will likely be limited by low head		Use poly-linear or impermeable membrane to seal bottom
Channels	Enhanced Swales	Generally feasible. However, slope <1% may lead to standing water in dry swales	Often infeasible if slopes are 4% or greater	
	Channels, Grass			
	Channels, Open			
Chemical Treatment	Alum Treatment System			
Conveyance System Components	Culverts			
	Energy Dissipation			
	Inlets/Street Gutters			
	Pipe Systems			
Detention	Detention, Dry		Embankment heights restricted	Require poly or clay liner, Max ponding depth, Geotechnical tests
	Detention, Extended Dry			
	Detention, Multi-purpose Areas			
	Detention, Underground			GENERALLY NOT ALLOWED
Filtration	Filter Strips			
	Organic Filters			
	Planter Boxes			
	Sand Filters, Surface/Perimeter	Several design variations will likely be limited by low head		Use poly-linear or impermeable membrane to seal bottom
	Sand Filters, Underground			
Hydrodynamic Devices	Gravity (Oil-Grit) Separator			
Infiltration	Downspout Drywell	Minimum distance to water table of 4 ft		GENERALLY NOT ALLOWED
	Infiltration Trenches	Minimum distance to water table of 2 ft	Maximum slope of 6%; trenches must have flat bottom	GENERALLY NOT ALLOWED
	Soakage Trenches	Minimum distance to water table of 4 ft	Maximum slope of 6%; trenches must have flat bottom	GENERALLY NOT ALLOWED
Ponds	Wet Pond	Limit maximum normal pool depth to about 4 ft (dugout) Providing pond drain can be problematic	Embankment heights restricted	Require poly or clay liner Max ponding depth Geotechnical tests
	Wet ED Pond			
	Micropool ED Pond			
	Multiple Ponds			
Porous Surfaces	Green Roof			
	Modular Porous Paver Systems			
	Porous Concrete			
Proprietary Systems	Proprietary Systems ¹			
Re-Use	Rain Barrels			
Wetlands	Wetlands, Stormwater		Embankment heights restricted	Require poly-liner Geotechnical tests
	Wetlands, Submerged Gravel			

¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.

Table 3.20 Soils		
Category	<i>integrated Stormwater Controls</i>	Soils
Bioretention Areas	Bioretention Areas	Clay or silty soils may require pretreatment
Channels	Enhanced Swales	
	Channels, Grass	
	Channels, Open	
Chemical Treatment	Alum Treatment System	
Conveyance System Components	Culverts	
	Energy Dissipation	
	Inlets/Street Gutters	
	Pipe Systems	
Detention	Detention, Dry	Underlying soils of hydrologic group "C" or "D" should be adequate to maintain a permanent pool. Most group "A" soils and some group "B" soils will require a pond liner.
	Detention, Extended Dry	
	Detention, Multi-purpose Areas	
	Detention, Underground	
Filtration	Filter Strips	
	Organic Filters	
	Planter Boxes	Type A or B
	Sand Filters, Surface/Perimeter	Clay or silty soils may require pretreatment
	Sand Filters, Underground	
Hydrodynamic Devices	Gravity (Oil-Grit) Separator	
Infiltration	Downspout Drywell	Infiltration rate > 0.5 inch/hr
	Infiltration Trenches	Infiltration rate > 0.5 inch/hr
	Soakage Trenches	Infiltration rate > 0.5 inch/hr
Ponds	Wet Pond	"A" soils may require pond liner "B" soils may require infiltration testing
	Wet ED Pond	
	Micropool ED Pond	
	Multiple Ponds	
Porous Surfaces	Green Roof	
	Modular Porous Paver Systems	Infiltration rate > 0.5 inch/hr
	Porous Concrete	
Proprietary Systems	Proprietary Systems ¹	
Re-Use	Rain Barrels	
Wetlands	Wetlands, Stormwater	"A" soils may require pond liner
	Wetlands, Submerged Gravel	

¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.

Table 3.21 Special Watershed Considerations				
Category	Integrated Stormwater Controls	Special Watershed Considerations		
		High Quality Stream	Aquifer Protection	Reservoir Protection
Bioretention Areas	Bioretention Areas	Evaluate for stream warming	Needs to be designed with no exfiltration (ie. outflow to groundwater)	
Channels	Enhanced Swales		Hotspot runoff must be adequately treated	Hotspot runoff must be adequately treated
	Channels, Grass			
	Channels, Open			
Chemical Treatment	Alum Treatment System			
Conveyance System Components	Culverts			
	Energy Dissipation			
	Inlets/Street Gutters			
	Pipe Systems			
Detention	Detention, Dry			
	Detention, Extended Dry			
	Detention, Multi-purpose Areas			
	Detention, Underground			
Filtration	Filter Strips			
	Organic Filters			
	Planter Boxes			
	Sand Filters, Surface/Perimeter	Evaluate for stream warming	Needs to be designed with no exfiltration (ie. outflow to groundwater)	
	Sand Filters, Underground			
Hydrodynamic Devices	Gravity (Oil-Grit) Separator			
Infiltration	Downspout Drywell			
	Infiltration Trenches		Maintain safe distance from wells and water table. No hotspot runoff	Maintain safe distance from bedrock and water table. Pretreat runoff
	Soakage Trenches			
Ponds	Wet Pond	Evaluate for stream warming	May require liner if "A" soils are present Pretreat hotspots 2 to 4 ft separation distance from water table	
	Wet ED Pond			
	Micropool ED Pond			
	Multiple Ponds			
Porous Surfaces	Green Roof			
	Modular Porous Paver Systems			
	Porous Concrete			
Proprietary Systems	Proprietary Systems ¹			
Re-Use	Rain Barrels			
Wetlands	Wetlands, Stormwater	Evaluate for stream warming	May require liner if "A" soils are present Pretreat hotspots 2 to 4 ft separation distance from water table	
	Wetlands, Submerged Gravel			

¹ = The application and performance of proprietary commercial devices and systems must be provided by the manufacturer and should be verified by independent third-party sources and data if used as a primary control.

Step 3 Location and Permitting Considerations

In the last step, a site designer assesses the physical and environmental features at the site to determine the optimal location for the selected structural control or group of controls. Table 3.22 provides a condensed summary of current restrictions as they relate to common site features that may be regulated under local, state, or federal law. These restrictions fall into one of three general categories:

- Locating a structural control within an area when expressly prohibited by law
- Locating a structural control within an area that is strongly discouraged, and is only allowed on a case by case basis. Local, state, and/or federal permits shall be obtained, and the applicant will need to supply additional documentation to justify locating the stormwater control within the regulated area.
- Structural stormwater controls must be setback a fixed distance from a site feature.

This checklist is only intended as a general guide to location and permitting requirements as they relate to siting of stormwater structural controls. Consultation with the appropriate regulatory agency is the best strategy.

Local Provisions: No local provisions added.

Site Feature	Location and Permitting Guidance
<p>Jurisdictional Wetland (Waters of the U.S)</p> <p>U.S. Army Corps of Engineers Regulatory Permit</p>	<ul style="list-style-type: none"> • Jurisdictional wetlands must be delineated prior to siting structural control. • Use of natural wetlands for stormwater quality treatment is contrary to the goals of the Clean Water Act and should be avoided. • Stormwater should be treated prior to discharge into a natural wetland. • Structural controls may also be <i>restricted</i> in local buffer zones. Buffer zones may be utilized as a non-structural filter strip (i.e., accept sheet flow). • Should justify that no practical upland treatment alternatives exist. • Where practical, excess stormwater flows should be conveyed away from jurisdictional wetlands.
<p>Stream Channel (Waters of the U.S)</p> <p>U.S. Army Corps of Engineers Section 404 Permit</p>	<ul style="list-style-type: none"> • All Waters of the U.S. (streams, ponds, lakes, etc.) should be delineated prior to design. • Use of any Waters of the U.S. for stormwater quality treatment is contrary to the goals of the Clean Water Act and should be avoided. • Stormwater should be treated prior to discharge into Waters of the U.S. • In-stream ponds for stormwater quality treatment are highly discouraged. • Must justify that no practical upland treatment alternatives exist. • Temporary runoff storage preferred over permanent pools. • Implement measures that reduce downstream warming.
<p>Texas Commission on Environmental Quality</p> <p>Groundwater Management Areas</p>	<ul style="list-style-type: none"> • Conserve, preserve, protect, recharge, and prevent waste of groundwater resources through Groundwater Conservation Districts • Groundwater Conservation District pending for Middle Trinity. • Detailed mapping available from Texas Alliance of Groundwater Districts.
<p>Texas Commission on Environmental Quality</p> <p>Surface Water Quality Standards</p>	<ul style="list-style-type: none"> • Specific stream and reservoir buffer requirements. • May be imperviousness limitations • May be specific structural control requirements. • TCEQ provides water quality certification – in conjunction with 404 permit • Mitigation will be required for imparts to existing aquatic and terrestrial habitat.

Table 3.22 Location and Permitting Checklist	
Site Feature	Location and Permitting Guidance
100-year Floodplain Local Stormwater review Authority	<ul style="list-style-type: none"> Grading and fill for structural control construction is generally discouraged within the 100-year floodplain, as delineated by FEMA flood insurance rate maps, FEMA flood boundary and floodway maps, or more stringent local floodplain maps. Floodplain fill cannot raise the floodplain water surface elevation by more than limits set by the appropriate jurisdiction.
Stream Buffer Check with appropriate review authority whether stream buffers are required	<ul style="list-style-type: none"> Consult local authority for stormwater policy. Structural controls are discouraged in the streamside zone (within 25 feet or more of streambank, depending on the specific regulations).
Utilities Local Review Authority	<ul style="list-style-type: none"> Call appropriate agency to locate existing utilities prior to design. Note the location of proposed utilities to serve development. Structural controls are discouraged within utility easements or rights of way for public or private utilities.
Roads TxDOT or DPW	<ul style="list-style-type: none"> Consult TxDOT for any setback requirement from local roads. Consult DOT for setbacks from State maintained roads. Approval must also be obtained for any stormwater discharges to a local or state-owned conveyance channel.
Structures Local Review Authority	<ul style="list-style-type: none"> Consult local review authority for structural control setbacks from structures. Recommended setbacks for each structural control group are provided in the performance criteria in this manual.
Septic Drain fields Local Health Authority	<ul style="list-style-type: none"> Consult local health authority. Recommended setback is a minimum of 50 feet from drain field edge or spray area.
Water Wells Local Health Authority	<ul style="list-style-type: none"> 100-foot setback for stormwater infiltration. 50-foot setback for all other structural controls.

4.0 *integrated* Construction Criteria

The chapter lays out the criteria and methods to be employed during construction to limit erosion and the discharge of sediment and other pollutants from construction sites.

4.1 Applicability

Requirements for temporary controls during construction are applicable to the following projects:

- Land disturbing activity of one acre or more or
- Land disturbing activity of less than one acre, where the activity is part of a common plan of development that is one acre or larger.

A common plan of development refers to a construction activity that is completed in separate stages, separate phases, or in combination with other construction activities.

Local Provisions:

Erosion controls are required for all construction sites.

4.2 Introduction

iSWM requires the use of temporary controls during construction to prevent or reduce the discharge of sediment and other pollutants from the construction site. The temporary controls are known as Best Management Practices (BMPs). BMPs may be activities, prohibitions, maintenance procedures, structural controls, operating procedures and other measures to prevent erosion and control the discharge of sediment and other pollutants.

Construction BMPs shall be considered when developing the Preliminary iSWM Plan and shall be coordinated with the Final iSWM Plans. Construction BMPs fall into three general categories: Erosion Control, Sediment Control, and Material and Waste Control. The first category prevents erosion, and the second catches soil from erosion that does occur. It is generally more effective and less expensive to prevent erosion than to treat turbid runoff. Material and waste controls are for other sources of stormwater pollutants on a construction site.

The following priorities shall be applied to the selection of construction BMPs:

- Retain native topsoil and natural vegetation in an undisturbed state by incorporating natural drainage features and buffer areas into the site design.
- Limit the area of disturbance and vehicle access to the site.
- Limit the extent of clearing operations, and phase construction operations to minimize the area disturbed at any one time.
- Stabilize disturbed areas as soon as possible (not at the end of construction), particularly in channels and on cut/fill slopes.
- Minimize the disturbance of steep slopes during construction, and minimize slope length and steepness.

- Coordinate stream crossings, and minimize the construction of temporary stream crossings.
- Provide sediment controls, including but not limited to perimeter controls, where stormwater discharges will occur from disturbed areas.
- Prevent tracking of sediment off-site through the establishment of stabilized construction entrances and exits.
- Control sediment and other contaminants from dewatering activities.
- Control discharges of construction materials and wastes.

State Requirements

In addition to the municipality requirements outlined in this chapter, land disturbing activities must comply with the Texas Commission on Environmental Quality (TCEQ) requirements under General Permit Number TXR150000, commonly referred to as the “Construction General Permit.” This permit contains requirements for a Storm Water Pollution Prevention Plan (SWP3), state and local notifications, and installation, maintenance, and inspection of best management practices on construction sites. The *Water Quality Technical Manual* contains guidance for preparing a SWP3. However, compliance with the Construction General Permit is beyond the scope of this iSWM Criteria Manual and is the sole responsibility of the construction site operator(s).

Local Provisions:

No local provisions added.

4.3 Criteria for BMPs during Construction

The iSWM Construction Plan shall include, but shall not be limited to, the following:

- Topography;
- Limits of all areas to be disturbed by construction activity, including off-site staging areas, utility lines, batch plants, and spoil/borrow areas;
- Location and types of erosion control, sediment control, and material and waste control BMPs;
- Construction details and notes for erosion control, sediment control, and material and waste control BMPs; and
- Inspections and maintenance notes.

BMPs and notes shall be provided for all the elements listed in this section, unless site conditions render an element not applicable. BMPs shall be selected and designed according to the technical criteria in the *Construction Controls Technical Manual*. Site data gathered and analyzed in Step 2 of the *integrated Development Process* shall be the basis for selecting BMPs.

The minimum design storm for temporary BMPs is the 2-year, 24-hour duration storm event.

Plans for temporary BMPs shall be prepared by a Certified Professional in Erosion and Sediment Control (CPESC) or a licensed engineer or registered landscape architect in the State of Texas who has documented experience in hydrology and hydraulics and erosion and sediment control.

Local Provisions:

No local provisions added.

4.3.1 Erosion Controls

Erosion control is first line of defense and the primary means of preventing stormwater pollution. They shall be designed to retain soil in place and to minimize the amount of sediment that has to be removed from stormwater runoff by other types of BMPs. Fact Sheets for different types of Erosion Control BMPs are in *Section 2.0 of the Construction Controls Technical Manual*.

Limits of Disturbance

On the iSWM Construction Plans, clearly show the limits of the area to be disturbed.

Design Criteria

- Minimize the disturbance of steep slopes.
- Constrain the disturbed area to the minimum necessary to construct the project.
- Include the contractor's staging area, borrow/spoil area, utilities and any other areas on or off site that will be disturbed in support of the construction activity.
- Specify construction fencing or similar protective measures to prevent disturbance of natural drainage features, trees, vegetative buffers and other existing features to be preserved.

Slope Protection

Slope protection shall be provided for disturbed or cut/fill slopes that are one vertical on three horizontal (3H:1V) or steeper, 50 feet in length or longer, or on highly erodible soils. Show the location and type of BMPs to on the plans.

Design Criteria

- Where feasible, add notes that prohibit disturbing the slope until final site grading.
- Where a stabilized discharge point is available, provide temporary berms or swales to direct stormwater away from the slope until the slope is stabilized.
- Check dams shall be used within swales that are cut down a slope.
- Temporary terraces, vegetated strips or equivalent linear controls shall be specified at regular intervals to break-up slopes longer than 50 feet until the slope is stabilized.
- Specify final stabilization measures to be initiated within 14 days of completing work on the slope.
- Hydromulch is prohibited for slope stabilization unless the slope is one vertical on five horizontal (5H:1V) or less.

Channel Protection

Show the location and type of BMPs used to prevent the erosion of channels, drainage ways, streambanks, and outfalls until permanent structures and final stabilization measures are installed.

Design Criteria

- Provide temporary energy dissipaters at discharge points.
- If final channel stabilization consists of vegetation, anchored erosion control blankets, turf reinforcement mats, or an equivalent BMP that is resistant to channel flow shall be installed until the vegetation is established.
- If the BMPs include check dams, velocity dissipaters or other structures that extend into the channel, the BMPs shall be designed by a licensed engineer to function under the flow conditions produced by

the design storm. The engineer shall verify that the BMPs will not divert flow or cause flooding of adjacent properties and structures.

- Specify final stabilization measures to be initiated within 14 days of completing work on the channel.

Temporary Stabilization

Temporary stabilization practices shall be specified for disturbed areas where work stops for 14 days or more.

Design Criteria

- Stabilization measures shall be appropriate for the time of year, site conditions, and estimated duration of use.
- Stabilization BMPs shall be provided for soil stockpiles.

Final Stabilization

Final stabilization practices shall be specified for disturbed areas that are not covered by buildings, pavement or other permanent structures upon completion of construction. Final stabilization measures shall be coordinated with the site's landscaping plan.

Design Criteria

- Final stabilization shall be specified to start within fourteen days of completing soil disturbing activities.
- If space is available, top soil shall be stockpiled during construction and distributed onto the surface of disturbed areas prior to final stabilization.
- If top soil has not been stockpiled, soil amendments (compost, fertilizer, etc.) shall be specified with the final stabilization measures.
- Final stabilization measures must provide a perennial vegetative cover with a uniform density of 70% of the native background vegetative cover or equivalent permanent measures (riprap, gabion, or geotextiles).
- Include notes requiring temporary BMPs be removed within 30 days of establishing final stabilization.

Local Provisions:

Erosion controls are required for all construction sites.

4.3.2 Sediment Controls

Sediment control BMPs shall be designed to capture sediment on the site when preventing erosion is not feasible due to on-going construction activity. Sediment control BMPs and their locations shall be designed to change with the different phases of construction as site conditions and drainage patterns change. Sediment controls for the initial phase of construction shall be installed before any site disturbing activities begin. Fact Sheets for different types of Sediment Control BMPs are in [Section 3.0 of the Construction Controls Technical Manual](#).

Sediment Barriers

Sediment barriers may be linear controls (silt fence, compost socks, sediment logs, wattles, etc.), check dams, berms, sediment basins, sediment traps, active treatment systems and other structural BMPs designed to capture sediment suspended in stormwater.

Design Criteria

- Sediment barriers shall be designed to treat the volume of runoff from the design storm.
- Sediment barriers are not required for areas of the site that are undisturbed.
- If linear controls are used as the only sediment barrier for a project, the linear control shall be provided at a rate of 100 linear feet per quarter-acre of disturbed area. A series of linear controls may be needed throughout the site and are not limited to the perimeter.
- Linear controls shall not be used across areas of concentrated flow, such as drainage ditches, swales and outfalls.
- A sediment basin shall be provided where stormwater runoff from 10 acres or more of disturbed area flows to a common drainage location, unless a basin is infeasible due to site conditions or public safety. The basin shall be designed for the volume of runoff from the total area contributing (on-site and off-site) to the common drainage location, not just the volume from the disturbed portion of the contributing area. Stormwater diversion BMPs may be used to divert stormwater from upslope areas away from and around the disturbed area to minimize the design volume of the sediment basin.
- Both existing topography and graded topography shall be evaluated when determining if 10 acres or more discharges to a common location.
- If a sediment basin is infeasible on a site of 10 acres or more, a series of smaller sediment traps and/or linear controls shall be provided throughout the site to provide an equivalent level of protection.
- Permanent detention and retention basins may be used as a sediment basin during construction if all sediment is removed upon completion of construction.

Perimeter Controls

A linear BMP shall be provided at all down slope boundaries of the construction activity and side slope boundaries where stormwater runoff may leave the site. Linear sediment barriers may be used to satisfy the requirement for perimeter controls.

Storm Drain Inlet Protection

Storm drain inlet protection shall not be used as a primary sediment control BMP unless all other primary controls are infeasible due to site configuration or the type of construction activity. Inlet protection is to intended to be a last line of defense in the event of a temporary failure of other sediment controls.

Design Criteria

- Municipality approval is required before installing inlet protection on public streets.
- Inlet protection shall only be specified for low point inlets where positive overflow is provided.
- Drainage patterns shall be evaluated to ensure inlet protection will not divert flow or flood the roadway or adjacent properties and structures.

Construction Access Controls

BMPs shall be provided to prevent off-site vehicle tracking of soil and pollutants.

Design Criteria

- Limit site access to one route during construction, if possible; two routes for linear projects.
- Design the access point(s) to be at the upslope side of the construction site. Do not place the construction access at the lowest point on the construction site.
- Specify rock stabilization or an equivalent BMP for all access points.

- Include notes requiring soil tracked onto public roads be removed at a frequency that minimizes site impacts and prior to the next rain event, if feasible.
- Using water to wash sediment from streets is prohibited.

Dewatering Controls

Water pumped from foundations, vaults, trenches and other low areas shall be discharged through a BMP or treated to remove suspended soil and other pollutants before the water leaves the site. The plans shall include notes that prohibit discharging the water directly into flumes, storm drains, creeks or other drainage ways. Where state or local discharge permit requirements exist for the pollutant(s) suspected of being in the water, the plan shall include the discharge permit conditions.

Local Provisions:

No local provisions added.

4.3.3 Material and Waste Controls

Notes shall be placed on the iSWM Construction Plan for the proper handling and storage of materials and wastes that can be transported by stormwater. At a minimum, notes shall be provided for the materials and wastes in Table 4.1. Additional notes and BMPs shall be provided if other potential pollutants are expected to be on-site. Construction details shall be provided when necessary to ensure proper installation of a material or waste BMP.

All material and waste sources shall be located a minimum of 50 feet away from inlets, swales, drainage ways, channels and waters of the U.S., if the site configuration provides sufficient space to do so. In no case shall material and waste sources be closer than 20 feet from inlets, swales, drainage ways, channels and waters of the U.S.

Table 4.1 Requirements for Materials and Wastes

Material or Waste Source	Requirements
Sanitary Facilities	Sanitary facilities shall be provided on the site, and their location shall be shown on the iSWM Construction Plan. The facilities shall be regularly serviced at the frequency recommended by the supplier for the number of people using the facility.
Trash and Debris	Show the location of trash and debris storage on the iSWM Construction Plan. Store all trash and debris in covered bins or other enclosures. Trash and debris shall be removed from the site at regular intervals. Containers shall not be allowed to overflow.
Chemicals and Hazardous Materials	The amount of chemicals and hazardous materials stored on-site shall be minimized and limited to the materials necessary for the current phase of construction. Chemicals and hazardous materials shall be stored in their original, manufacturer's containers inside of a shelter that prevents contact with rainfall and runoff. Hazardous material storage shall be in accordance with all Federal, state and local laws and regulations. Storage locations shall have appropriate placards and secondary containment equivalent to 110% of the largest container in storage. If an earthen pit or berm is used for secondary containment, it shall be lined with plastic. Containers shall be kept

Table 4.1 Requirements for Materials and Wastes

Material or Waste Source	Requirements
	closed except when materials are added or removed. Materials shall be dispensed using drip pans or within a lined, bermed area or using other spill/overflow protection measures.
Fuel Tanks	On-site fuel tanks shall be provided with a secondary enclosure equivalent to 110% of the tank's volume. If the enclosure is an earthen pit or berm, the area shall be lined with plastic. Show the location of fuel tanks and their secondary containment on the iSWM Construction Plan.
Concrete Wash-out Water	An area shall be designated on the iSWM Construction Plan for concrete wash-out. A pit or bermed area, lined with plastic, or an equivalent containment measure shall be provided for concrete wash-out water. The containment shall be a minimum of 6 CF for every 10 CY of concrete placed plus a one foot freeboard. The discharge of wash-out water to drainage ways or storm drain infrastructure shall be prohibited.
Hyper-chlorinated Water from Water Line Disinfection	Hyper-chlorinated water shall not be discharged to the environment unless the chlorine concentration is reduced to 4 ppm or less by chemically treating to dechlorinate or by on-site retention until natural attenuation occurs. Natural attenuation may be aided by aeration. Water with measurable chlorine concentration of less than 4 ppm is prohibited from being discharged directly to surface water. It shall be discharged onto vegetation or through a conveyance system for further attenuation of the chlorine before it reaches surface water. Alternatively, permission from the sanitary sewer operator may be obtained to discharge directly to the sanitary sewer.
Vehicle/Equipment Wash Water	Vehicle and equipment washing is prohibited on the site unless a lined basin is provided to capture 100% of the wash water. The wash water may be allowed to evaporate or hauled-off for disposal.
Soil Stabilizers	Lime or other chemical stabilizers shall be limited to the amount that can be mixed and compacted by the end of each working day. Stabilizers shall be applied at rates that result in no runoff. Stabilization shall not occur immediately before and during rainfall events. Soil stabilizers stored on-site shall be considered a hazardous material and shall meet all the requirements for chemicals and hazardous materials.
Concrete Saw-cutting Water	Slurry from concrete cutting shall be vacuumed or otherwise recovered and not be allowed to discharge from the site. If the pavement to be cut is near a storm drain inlet, the inlet shall be protected by sandbags or equivalent temporary measures to prevent the slurry from entering the inlet.

Local Provisions:

No local provisions added.

4.3.4 *Installation, Inspection and Maintenance*

The iSWM Construction Plan shall include details and notes that specify the proper installation, inspection and maintenance procedures for BMPs. The BMPs for the initial phase of construction must be implemented before starting any activities that result in soil disturbance, including land clearing. Notes shall indicate the sequence of BMP installation for subsequent phases of construction.

Notes on the iSWM Construction Plan shall indicate the frequency of inspections and the areas to be inspected. Inspections shall include:

- Inspecting erosion and sediment controls to ensure that they are operating correctly;
- Inspecting locations where vehicles enter or exit the site for evidence of off-site tracking;
- Inspecting material and waste controls to ensure they are effective; and
- Inspecting the perimeter of disturbed areas and discharge points for evidence of sediment or other pollutants that may have been discharged.

Erosion, sediment, and material and waste controls shall be repaired, replaced, modified and/or added if inspections reveal the controls were not installed correctly, are damaged, or are inadequate or ineffective in controlling their targeted pollutant.

Notes for maintenance of BMPs shall require the removal of sediment from BMPs when the sediment reaches half of the BMP's capacity or more frequently. Sediment discharged from the site shall be removed prior to the next rain event, where feasible, and in no case later than seven days after it is discovered. Upon completion of construction, sediment shall be removed from all storm drain infrastructure and permanent BMPs before the temporary BMPs are removed from the site.

Local Provisions:

No local provisions added.

5.0 Additional Local Requirements

Table of Contents

5.0 Additional Local Requirements	71
5.1 Definitions.....	72
5.2 City of Hurst Development Process	73
5.2.1 Development Process Flowchart	73
5.2.2 Development Process Checklists.....	75
5.3 Tarrant County Rainfall Data.....	92
5.4 Runoff Coefficients for Rational Method	93
5.5 Structural Controls in Series	94
5.6 City of Hurst Draft Water Quality Option 1:.....	95
5.7 Example Storm Drain Line Designations and Call Outs	97

5.1 Definitions

Development – Manmade changes to a parcel that results in vertical development or increased impervious area.

Redevelopment – Manmade changes to a parcel that results in vertical development or a change impervious area.

Adverse Impacts – Changes in hydraulics or hydrology that negatively affect properties upstream or downstream such as increases in water surface elevation, velocity, or volume.

5.2 City of Hurst Development Process

5.2.1 Development Process Flowchart



City of Hurst - Development Review Process

Applicant contacts the City to set up a Pre-Development Conference

Pre-Development Conference will be held with City staff to review the proposed project. A Concept Plan shall be submitted at the meeting and include information listed in the checklist.(Sub. Div. Reg. Section 21-3(c))

Subdivision Approval Process – when any tract of land is divided into 2 or more parts, before sale or improvement of land (Subdivision Ordinance)

Development Approval Process for Platted Properties (Zoning Ordinance)

The property IS NOT properly Zoned

The property IS properly Zoned

The property IS NOT properly Zoned

The property IS properly Zoned

Applicant applies for Rezoning and is approved or denied.

Applicant applies for Rezoning and is approved or denied.

Preliminary Plat and Preliminary Engineering Plans submitted based on checklists. Eight copies submitted to the City, at least 28 days prior to the regular meeting at which the preliminary plat is sought to be filed. Approval must be given through P&Z and then City Council. Approval expires at the end of 9 months unless the final plat has been submitted.

Preliminary Engineering Plans Submitted for Short-form/Re-Plat based on checklists. Must be conditions of Sub. Div. Reg. Section 21-6. Two Mylar copies and eight print copies submitted to the City, at least 28 days prior to the regular meeting at which the preliminary plat is sought to be filed.

Preliminary Engineering Plans Submitted based on checklists.

Final Plat Submitted to the City of Hurst Development office by 2:00PM on the 21st day prior to the P and Z Commission Meeting. Follow the Final Plat Checklist.

Final Engineering and Architectural Plans Submitted

Site Plan Submitted

Comments/Mark-Ups are provided to applicant

Documents sent to Engineering and Planning Departments for internal review.

Updated plans received and reviewed

Plat sent to P&Z and then City Council for approval

Site Plan sent to P&Z and then City Council for approval

Pre-Construction Meeting Held

Permits and Fees Submitted and Approved

Final Plat is Filed with County Clerk

Site Plan filed with City Secretary

Construction Phase

As-Builts Submitted and Filed

5.2.2 *Development Process Checklists*

CITY OF HURST
Public Works Department
SITE PLAN PLAN CHECKLIST



SITE PLAN CHECKLIST

- Submit a notarized letter giving the applicant permission from the owner(s) to request site plan approval.
- Submit twelve (12) prints of the Site Plan of the proposed development drawn at an engineering scale of 1" = 200' or larger on a sheet size **24" x 36" FOLDED** to an 8 1/2"x11" size.
- Submit one (1) 11"x17" print of the Site Plan.
- If the applicant is requesting an SPUD (site with less than 5 acres) he should refer to Section 15.3-2 SPUD Area Requirements of the Zoning Ordinance.
- The following items are required to be shown on the Site Plan or are to be submitted with the Site Plan for consideration. Please use the column on the left to verify the completeness of information submitted.

INDICATE IF DATA IS:

ON PLAN

N/A

I. BASIC INFORMATION

- | | | |
|---------------|---------------|---|
| <u> </u> | <u> </u> | A. Detailed legal description (metes and bounds) of proposed site |
| <u> </u> | <u> </u> | B. Location and size or width of all public R.O.W. and/or easements intersecting the site |
| <u> </u> | <u> </u> | C. Acreage of proposed site |
| <u> </u> | <u> </u> | D. Acreage of abutting tracts |
| <u> </u> | <u> </u> | E. Zoning of all abutting tracts |
| <u> </u> | <u> </u> | F. Proposed finished grade of site, contour interval not to exceed two (2) feet |

ON PLAN

N/A

II. BUILDING INFORMATION

- | | | |
|---------------|---------------|---|
| <u> </u> | <u> </u> | A. Location of existing structures |
| <u> </u> | <u> </u> | B. Location of proposed structures |
| <u> </u> | <u> </u> | C. Proposed use of each structure |
| <u> </u> | <u> </u> | D. Number of stories and height of each structure |
| <u> </u> | <u> </u> | E. Gross floor area of all structures in square feet |
| <u> </u> | <u> </u> | F. Location of entrances and exits to all buildings |
| <u> </u> | <u> </u> | G. Front, rear, and side elevation drawing of each building (submit 8 copies) |

ON PLAN

N/A

III. GROUNDS/LANDSCAPING

- | | | |
|---------------|---------------|---|
| <u> </u> | <u> </u> | A. Landscaping, height and design of all walls, fences, and screening plants (submit 8 copies) |
| <u> </u> | <u> </u> | B. Location and description of required landscaping (proportion of site and square footage) |
| <u> </u> | <u> </u> | C. Location and layout of irrigation system |
| <u> </u> | <u> </u> | D. The location, size, height, orientation and design of all signs (submit 8 copies) |
| <u> </u> | <u> </u> | E. Location of all fire hydrants, on-site and off-site |
| <u> </u> | <u> </u> | F. Location of all existing and/or proposed utility lines |
| <u> </u> | <u> </u> | G. Location of all existing and/or proposed drainage facilities that meet the City of Hurst iSWM Criteria Manual requirements (if applicable) |

CITY OF HURST
Public Works Department
SITE PLAN PLAN CHECKLIST



INDICATE IF DATA IS:

ON PLAN

N/A

IV. PARKING AREA

- | | | |
|-------|-------|--|
| _____ | _____ | A. Parking area in square feet |
| _____ | _____ | B. Total number of parking spaces provided |
| _____ | _____ | C. Marked parking stalls showing width, depth, and parking layout dimensions |
| _____ | _____ | D. Parking stalls marked and designated for handicapped persons |
| _____ | _____ | E. Driveway line markings and wheel stop locations |
| _____ | _____ | F. Parking areas marked and designated for emergency vehicles |
| _____ | _____ | G. Location and size of loading areas |
| _____ | _____ | H. Location of outside waste facilities and screening |
| _____ | _____ | I. Pedestrian walks, malls, and open areas shown and dimensioned |
| _____ | _____ | J. Type and location of all illumination facilities |
| _____ | _____ | K. Location and width of all curb cuts and driving lanes |
| _____ | _____ | L. Types of surfacing to be used |
| _____ | _____ | M. Fire lanes |

Owner/Developer Signature _____

Consulting Engineer Signature _____

<u>FOR CITY USE</u>		
Received By: _____	Date: _____	Time: _____
Reviewed By: _____	Date: _____	

CITY OF HURST
Public Works Department
CONCEPT PLAN CHECKLIST



GENERAL INFORMATION

Project Title: _____

Name of Record Owners: _____

Address of Record Owners: _____

Name of Developer: _____ Phone: _____

Address of Developer: _____

Name of Engineer/Planner/Surveyor: _____ Phone: _____

Address of Engineer/Planner/Surveyor: _____

General Location of Property: _____

Present Zoning District: _____ Zoning Change? **Y** **N** Requested Change: _____

Proposed Land Use:

<u>Land Use</u>	<u>No. of Lots or Units</u>	<u>Acres</u>	<u>Building Space (ft²)</u>
Single Family	_____	_____	_____
Garden/Patio/Zero-lot Line	_____	_____	_____
Duplex	_____	_____	_____
Townhouses	_____	_____	_____
Triplex/Quadruplex	_____	_____	_____
Multi-Family Condos/Apartments	_____	_____	_____
Office	_____	_____	_____
Retail/Restaurant	_____	_____	_____
Commercial	_____	_____	_____
Warehouse/Showroom	_____	_____	_____
Industrial	_____	_____	_____
Public Street R.O.W	_____	_____	_____
Parks, Public Facilities	_____	_____	_____
Other Land Uses	_____	_____	_____
Total	_____	_____	_____

CITY OF HURST
Public Works Department
CONCEPT PLAN CHECKLIST



CONCEPT PLAN CHECKLIST

The Concept Plan shall be submitted during the Pre-Development Conference with City Staff.

Submit two (2) prints of the Concept Plan. The Concept Plan should be drawn to an engineering scale of 1" = 100' or larger on a sheet 24" x 36".

The following items are required to be shown on the concept plan or submitted with the concept plan for consideration. Please use the boxes at the left to verify the completeness of the information submitted. "N/A" is the abbreviation for "Not Applicable" on this checklist.

INDICATE IF DATA IS:

ON PLAN

N/A

I. BASIC INFORMATION

A. Project Name

B. City

C. County

D. State

E. Name and Address of Owner

F. "Concept Plan" Title

G. Name and Address of Engineer/Planner/Surveyor Responsible for Design

ON PLAN

N/A

II. GENERAL SITE INFORMATION

A. Acreage of site

B. Name(s) of adjacent subdivisions

C. Names of streets (existing and proposed)

D. Lot and Block Numbers

E. Aerial imagery

F. Existing topography

G. Locations, names, and widths of adjacent and/or intersecting streets, alleys, and easements

H. Label all proposed easements and note if dedicated to the City or private.

I. Current and proposed property boundary lines

ON PLAN

N/A

III. INTERIOR DETAILS

A. Show and label approximate shape and placement of buildings

B. For each building, label proposed use and building height (# of stories)

C. Existing natural features on property (FEMA Special Flood Hazard Areas, existing ponds, tree canopy limits, hydrologic soil groups A or B)

D. Areas of existing and proposed impervious cover

E. Areas of existing and proposed pervious cover (including landscaping areas)

ON PLAN

N/A

IV. STREETS

A. Show and dimension approximate ROW and/or easement widths for existing and proposed

CITY OF HURST
Public Works Department
CONCEPT PLAN CHECKLIST



INDICATE IF DATA IS:

- | | | |
|----------------|------------|---|
| _____ | _____ | B. Show points of access |
| _____ | _____ | V. WATER AND SEWER |
| _____ | _____ | A. Existing water lines shown (location, material type, and size) |
| _____ | _____ | B. Existing sanitary sewer lines shown (location, material type, and size) |
| <u>ON PLAN</u> | <u>N/A</u> | VI. ON SITE AND OFF SITE DRAINAGE |
| _____ | _____ | A. Existing drainage facilities |
| _____ | _____ | B. Conceptual location and types of drainage facilities |
| _____ | _____ | C. Discuss proposed means of meeting water quality requirements (sites >1 acre) |
| _____ | _____ | D. Discuss watershed location and availability of existing hydrologic models |
| <u>ON PLAN</u> | <u>N/A</u> | VII. DRAFTING DETAILS |
| _____ | _____ | A. Date |
| _____ | _____ | B. Scale |
| _____ | _____ | C. North Arrow (shown pointing up or to the right) |
| _____ | _____ | D. Small scale location map |

Owner/Developer Signature _____

Consulting Engineer Signature _____

<u>FOR CITY USE</u>		
Received By: _____	Date: _____	Time: _____
Date of Pre-Development Conference: _____		
Reviewed By: _____	Date: _____	

CITY OF HURST
Public Works Department
PRELIMINARY PLAT AND ENGINEERING PLAN CHECKLIST



GENERAL INFORMATION

Project Title: _____

Name of Record Owners: _____

Address of Record Owners: _____

Name of Developer: _____ Phone: _____

Address of Developer: _____

Name of Engineer/Planner/Surveyor: _____ Phone: _____

Address of Engineer/Planner/Surveyor: _____

General Location of Property: _____

Present Zoning District: _____ Zoning Change? **Y** **N** Requested Change: _____

Proposed Land Use:

<u>Land Use</u>	<u>No. of Lots or Units</u>	<u>Acres</u>	<u>Building Space (ft²)</u>
Single Family	_____	_____	_____
Garden/Patio/Zero-lot Line	_____	_____	_____
Duplex	_____	_____	_____
Townhouses	_____	_____	_____
Triplex/Quadruplex	_____	_____	_____
Multi-Family Condos/Apartments	_____	_____	_____
Office	_____	_____	_____
Retail/Restaurant	_____	_____	_____
Commercial	_____	_____	_____
Warehouse/Showroom	_____	_____	_____
Industrial	_____	_____	_____
Public Street R.O.W	_____	_____	_____
Parks, Public Facilities	_____	_____	_____
Other Land Uses	_____	_____	_____
Total	_____	_____	_____

CITY OF HURST
Public Works Department
PRELIMINARY PLAT AND ENGINEERING PLAN CHECKLIST



PRELIMINARY PLAT CHECKLIST

The Subdivision Ordinance of the City of Hurst contains instructions to guide the preparation and submittal of preliminary plats.

Submit twelve (12) prints of the Preliminary Plat folded to 8 1/2" x 11" size. The preliminary plat should be drawn to an engineering scale of 1" = 100' or larger on a sheet 24" x 36".

Submit one (1) legible 11" x 17" print of the preliminary plat.

The following items are required to be shown on the preliminary plat or submitted with the preliminary plat for consideration. Please use the boxes at the left to verify the completeness of the information submitted. "N/A" is the abbreviation for "Not Applicable" on this checklist.

INDICATE IF DATA IS:

<u>ON PLAT</u>	<u>N/A</u>	
_____	_____	I. BASIC INFORMATION
_____	_____	A. Subdivision Name
_____	_____	B. City
_____	_____	C. County
_____	_____	D. State
_____	_____	E. Name and Address of Owner and/or lien holders
_____	_____	F. "Preliminary Plat" Title
_____	_____	G. Name and Address of Engineer/Planner/Surveyor Responsible for Design
<u>ON PLAT</u>	<u>N/A</u>	II. IDENTIFICATION
_____	_____	A. Name(s) of adjacent subdivisions
_____	_____	B. Names of streets (existing and proposed)
_____	_____	C. Lot and Block Numbers
_____	_____	D. Title Report
<u>ON PLAT</u>	<u>N/A</u>	III. SURVEYING
_____	_____	A. Boundary survey of plat (bearings and distances)
_____	_____	B. Reference to original survey or previous subdivision
_____	_____	C. Locations, names, and widths of adjacent and/or intersecting streets, alleys, and easements
_____	_____	D. Label all easements and note if dedicated to the City or private.
_____	_____	E. Reference and location of all surrounding subdivisions, tracts, etc.
_____	_____	F. Field notes and metes and bounds description
<u>ON PLAT</u>	<u>N/A</u>	IV. INTERIOR DETAILS
_____	_____	A. Acreage of site
_____	_____	B. Dimension and location of all lots, streets, easements, parks, etc.
_____	_____	C. Existing Natural and artificial physical features or property (ditches, creeks, woods, bridges, culverts, etc.)

CITY OF HURST
Public Works Department
PRELIMINARY PLAT AND ENGINEERING PLAN CHECKLIST



INDICATE IF DATA IS:

- | | | |
|----------------|------------|---|
| <u>ON PLAT</u> | <u>N/A</u> | V. LEGAL STIPULATIONS |
| _____ | _____ | A. Copy of all deed restrictions pertaining to the subject property |
| <u>ON PLAT</u> | <u>N/A</u> | VI. CERTIFICATION |
| _____ | _____ | A. Survey is performed by licensed surveyor |
| <u>ON PLAT</u> | <u>N/A</u> | VII. DRAFTING DETAILS |
| _____ | _____ | A. Date |
| _____ | _____ | B. Scale |
| _____ | _____ | C. North Arrow (shown pointing up or to the right) |
| _____ | _____ | D. Small scale location map |

PRELIMINARY ENGINEERING PLAN CHECKLIST

Submit four (4) prints of the Preliminary Engineering Plans. The preliminary engineering plans should be drawn to an engineering scale of 1" = 100' or larger on a sheet 24" x 36". Profiles shall have an engineering scale of 1" = 40' horizontal and 1" = 4' vertical.

The following items shall be required, when applicable, for completion of the construction plans. Please use the column on the left to verify the completeness of information submitted. "N/A" is the abbreviation for "Not Applicable" on this checklist.

INDICATE IF DATA IS:

- | | | |
|-----------------|------------|---|
| <u>ON PLANS</u> | <u>N/A</u> | I. STREETS |
| _____ | _____ | A. ROW dimension shown for all existing streets |
| _____ | _____ | B. ROW dimension shown for all proposed streets |
| | | i. Residential (2 lane undivided, 50 feet) |
| | | ii. Secondary Collector (2 lane undivided, 50 feet**) |
| | | iii. Primary Collector (4 lane undivided, 60 feet**) |
| | | iv. Minor Arterial (4 lane divided, 100 feet) |
| | | v. Major Arterial (6 lane divided, 120 feet*) |
| | | ** 10 ft. additional at intersections with collectors |
| | | * 10 ft. additional per turn lane where more than one turn lane is required |
| _____ | _____ | C. Additional street ROW, if required |
| | | If required, street: _____ |
| | | Dedication: _____ |
| _____ | _____ | D. Alignment of proposed street with existing streets (minimum 125 foot offset) |
| _____ | _____ | E. Extension of collectors and arterials (Thoroughfare Plan) |
| _____ | _____ | F. Preliminary street plans |
| _____ | _____ | i. Minimum pavement thickness for various street widths is in accordance with the most current revision of the City's Standard Specification for Paving |

CITY OF HURST
Public Works Department
PRELIMINARY PLAT AND ENGINEERING PLAN CHECKLIST



INDICATE IF DATA IS:

ON PLANS N/A

- ii. Minimum centerline radius
Residential – 395 feet
Collectors – 498 feet
Arterials – 637 feet

- iii. No street with one point of access should be longer than 500 feet

- iv. Block length: >290 feet and < 1,200 feet measured centerline to centerline

ON PLANS N/A

II. WATER AND SEWER AVAILABILITY

- A. Existing water lines shown (location, material type, and size)

- B. Existing sanitary sewer lines shown (location, material type, and size)

- C. Preliminary plans of proposed water distribution

- i. Fire hydrants shown
Residential – 300 foot radius coverage
Commercial and Industrial – 300 foot radius coverage

- D. Preliminary plans of proposed sewer collection

- E. Presence of a City of Hurst water/sewer easement where lines are adjacent to a street

ON PLANS N/A

III. ON SITE AND OFF SITE DRAINAGE

- A. Drainage area map

- i. Existing topography

- ii. Existing on-site drainage facilities

- iii. Existing off-site drainage facilities

- B. Proposed lot and block grading plan

- C. Plan view of proposed drainage facilities (location, material type, and preliminary size)

- D. Profile view of proposed drainage pipes (elevations and estimated conflict locations)

- E. Preliminary plans for meeting water quality requirements (City of Hurst iSWM Criteria Manual Section 3.2)

- i. Option 1: Provide draft scoresheet and show locations of practices in the plans.
- ii. Option 2: Show the types and locations of BMPs proposed with water quality volume calculations.
- iii. Option 3: Discuss the requirements for approval with the Public Works Director or designee

- F. Show and label all existing and proposed easements.

- G. Draft of downstream assessment report showing no adverse impacts

- H. Determination of public or private maintenance for drainage controls

CITY OF HURST
Public Works Department
PRELIMINARY PLAT AND ENGINEERING PLAN CHECKLIST



INDICATE IF DATA IS:

ON PLANS

N/A

IV. MISCELLANEOUS

A. Indicate other utilities (i.e. gas, electric, cable, telephone)

B. Indicate existing and proposed street light locations

Owner/Developer Signature _____

Consulting Engineer Signature _____

FOR CITY USE

Received By: _____ Date: _____ Time: _____

Fees Paid: _____

Reviewed By: _____ Date: _____

CITY OF HURST
Public Works Department
FINAL PLAT (REPLAT) AND ENGINEERING PLAN CHECKLIST



GENERAL INFORMATION

Project Title: _____

Name of Record Owners: _____ Phone: _____

Address of Record Owners: _____

Name of Developer: _____ Phone: _____

Address of Developer: _____

Name of Engineer/Planner/Surveyor: _____ Phone: _____

Address of Engineer/Planner/Surveyor: _____

General Location of Property: _____

Present Zoning District: _____ Zoning Change? **Y N** Requested Change: _____

Zoning Change Case File No.: _____ Rezoning Exhibit/Checklist Submitted: **Y N** Date: _____

Proposed Land Use:

<u>Land Use</u>	<u>No. of Lots or Units</u>	<u>Acres</u>	<u>Building Space (ft²)</u>
Single Family	_____	_____	_____
Garden/Patio/Zero-lot Line	_____	_____	_____
Duplex	_____	_____	_____
Townhouses	_____	_____	_____
Triplex/Quadruplex	_____	_____	_____
Multi-Family Condos/Apartments	_____	_____	_____
Mobile Homes	_____	_____	_____
Office	_____	_____	_____
Retail/Restaurant	_____	_____	_____
Commercial	_____	_____	_____
Warehouse/Showroom	_____	_____	_____
Industrial	_____	_____	_____
Public Street R.O.W	_____	_____	_____
Parks, Public Facilities	_____	_____	_____
Other Land Uses	_____	_____	_____
Total	_____	_____	_____

CITY OF HURST
Public Works Department
FINAL PLAT (REPLAT) AND ENGINEERING PLAN CHECKLIST



FINAL PLAT (REPLAT) CHECKLIST

The Subdivision Ordinance of the City of Hurst contains instructions to guide the preparation and submittal of final plats.

Submit twelve (12) prints of the Final Plat folded to 8 1/2" x 11" size. The final plat should be drawn to an engineering scale of 1" = 100' or larger on a sheet 24" x 36".

Submit two (2) full scale mylars and one (1) legible 11" x 17" print of the final plat.

Replat Requirements

Approval of platting under the replat (short form) procedure eliminates the necessity for a preliminary plat as required by the Subdivision Ordinance of the City of Hurst. The proposed plat or replat must adhere to the stipulations set forth in Section 21 of the Subdivision Ordinance in order to qualify for the replat (short form) procedure. Fees for replatting (short form) shall be the same as for final plats.

The following items are required to be shown on the final plat/replat or submitted with the final plat/replat for consideration. Please use the boxes at the left to verify the completeness of the information submitted. "N/A" is the abbreviation for "Not Applicable" on this checklist.

REQUESTING:

Replat (Short Form): The correction or adjustment of an existing plat filed with Tarrant County.

Volume and page of most recently filed plat on the subject property: _____

Final Plat (Short): Original platting of property

INDICATE IF DATA IS:

<u>ON PLAT</u>	<u>N/A</u>	
_____	_____	I. BASIC INFORMATION
_____	_____	A. Subdivision Name
_____	_____	B. City
_____	_____	C. County
_____	_____	D. State
_____	_____	E. Name and Address of Owner and/or lien holders
_____	_____	F. "Final Plat" or "Replat" Title
_____	_____	G. Name and Address of Engineer/Planner/Surveyor Responsible for Design
<u>ON PLAT</u>	<u>N/A</u>	II. IDENTIFICATION
_____	_____	A. Name(s) of adjacent subdivisions
_____	_____	B. Names of streets (existing and proposed)
_____	_____	C. Lot and Block Numbers
_____	_____	D. Title Report
<u>ON PLAT</u>	<u>N/A</u>	III. SURVEYING
_____	_____	A. Boundary survey of plat (bearings and distances)
_____	_____	B. Reference to original survey or previous subdivision
_____	_____	C. Locations, names, and widths of adjacent and/or intersecting streets, alleys, and easements
_____	_____	D. Label all easements and note if dedicated to the City or private.
_____	_____	E. Reference and location of all surrounding subdivisions, tracts, etc.

CITY OF HURST
Public Works Department
FINAL PLAT (REPLAT) AND ENGINEERING PLAN CHECKLIST



INDICATE IF DATA IS:

_____	_____	F. Field notes and metes and bounds description
<u>ON PLAT</u>	<u>N/A</u>	
_____	_____	IV. INTERIOR DETAILS
_____	_____	A. Acreage of Site
_____	_____	B. Dimension and location of all lots, streets, easements, parks, etc.
_____	_____	C. Existing natural and artificial physical features or property (ditches, creeks, woods, bridges, culverts, etc.)
_____	_____	D. Detail curve information
_____	_____	E. Building lines (exterior and interior)
_____	_____	F. Fire lanes
<u>ON PLAT</u>	<u>N/A</u>	V. DEDICATION
_____	_____	A. Signed by Owner(s)
_____	_____	B. Accompanying plat
_____	_____	C. Notarized
<u>ON PLAT</u>	<u>N/A</u>	VI. LEGAL AND FINANCIAL DETAILS
_____	_____	A. Copy of all deed restrictions pertaining to the subject property
_____	_____	B. Certificates of all past and current taxes paid on property being platted
_____	_____	C. Participation request (streets, storm sewer, sanitary sewer, and water) submitted in completed form
_____	_____	D. Pro-rata assessment (water and sewer)
_____	_____	E. Escrow agreement and deposit
_____	_____	F. Copy of Home Owners Association or developers agreement
<u>ON PLAT</u>	<u>N/A</u>	VII. CERTIFICATION
_____	_____	A. Survey is performed by licensed surveyor
_____	_____	B. Monuments shown on plat
_____	_____	C. Monuments set in field
_____	_____	D. Space provided for Planning and Zoning and City Council approval
<u>ON PLAT</u>	<u>N/A</u>	VIII. DRAFTING DETAILS
_____	_____	A. Date
_____	_____	B. Scale
_____	_____	C. North Arrow (shown pointing up or to the right)
_____	_____	D. Small scale location map
<u>ON PLAT</u>	<u>N/A</u>	IX. SITE AND LANDSCAPING PLANS (if available, submit 3 copies)
_____	_____	A. Adheres to the landscape and lot area requirements outlined in the Zoning Ordinance

CITY OF HURST
Public Works Department
FINAL PLAT (REPLAT) AND ENGINEERING PLAN CHECKLIST



FINAL ENGINEERING PLAN CHECKLIST

Submit four (4) prints of the Final Engineering Plans. The final engineering plans should be drawn to an engineering scale of 1" = 100' or larger on a sheet 24" x 36". Plans showing profiles shall have an engineering scale of 1" = 40' horizontal and 1" = 4' vertical.

The following items shall be required, when applicable, for completion of the construction plans. Please use the column on the left to verify the completeness of information submitted. "N/A" is the abbreviation for "Not Applicable" on this checklist.

INDICATE IF DATA IS:

<u>ON PLANS</u>	<u>N/A</u>	
_____	_____	I. STREETS
_____	_____	A. ROW dimension shown for all existing streets
_____	_____	B. ROW dimension shown for all proposed streets <ul style="list-style-type: none"> i. Residential (2 lane undivided, 50 feet) ii. Secondary Collector (2 lane undivided, 50 feet**) iii. Primary Collector (4 lane undivided, 60 feet**) iv. Minor Arterial (4 lane divided, 100 feet) v. Major Arterial (6 lane divided, 120 feet*) ** 10 ft. additional at intersections with collectors * 10 ft. additional per turn lane where more than one turn lane is required
_____	_____	C. Additional street ROW, if required If required, street: _____ Dedication: _____
_____	_____	D. Alignment of proposed street with existing streets (minimum 125 foot offset)
_____	_____	E. Extension of collectors and arterials (Thoroughfare Plan)
_____	_____	F. Final street plans <ul style="list-style-type: none"> i. Minimum pavement thickness for various street widths is in accordance with the most recent revision of the City's Specification for Paving. ii. Minimum centerline radius Residential – 395 feet Collectors – 498 feet Arterials – 637 feet iii. No street with one point of access should be longer than 500 feet iv. Block length: >290 feet and < 1,200 feet measured centerline to centerline v. If existing, show curbs and other appurtenances vi. City of Hurst Standard "Street and Driveway Details Sheet" vii. City of Hurst Standard "Miscellaneous Sidewalk Details" Sheet viii. City of Hurst Standard "Typical Barricading Plan" Sheet
_____	_____	
_____	_____	
_____	_____	
_____	_____	
_____	_____	
_____	_____	
_____	_____	
_____	_____	
<u>ON PLANS</u>	<u>N/A</u>	II. WATER AND SEWER AVAILABILITY
_____	_____	A. Existing water lines shown (location, material type, and size)
_____	_____	B. Existing sanitary sewer lines shown (location, material type, and size)

CITY OF HURST
Public Works Department
FINAL PLAT (REPLAT) AND ENGINEERING PLAN CHECKLIST



INDICATE IF DATA IS:

		<ul style="list-style-type: none"> C. Final plans of proposed water distribution <ul style="list-style-type: none"> i. Fire hydrants shown Residential – 300 foot radius coverage Commercial and Industrial – 300 foot radius coverage ii. Water mains shown in profile iii. City of Hurst Standard “Water Line Details” Sheet iv. City of Hurst Standard “Miscellaneous Details Water Line” Sheet
		<ul style="list-style-type: none"> D. Final plans of proposed sewer collection <ul style="list-style-type: none"> i. Manholes Spacing – 500 feet or less Install at junctions, bends, and end of lines ii. City of Hurst Standard “Standard Details for Sanitary Sewers” (2 sheets)
		E. City of Hurst “Water and Sewer Standard Notes”
<u>ON PLANS</u>	<u>N/A</u>	III. ON SITE AND OFF SITE DRAINAGE
		<ul style="list-style-type: none"> A. Drainage area map <ul style="list-style-type: none"> i. Existing topography ii. Existing on-site drainage facilities iii. Existing off-site drainage facilities iv. Entire drainage area (on-site and off-site) v. Drainage calculations
		<ul style="list-style-type: none"> B. Proposed lot and block grading plan <ul style="list-style-type: none"> i. Lots should drain to street or to an improved drainage structure ii. Elevations should be shown at all property corners and tops of curbs
		<ul style="list-style-type: none"> C. Proposed drainage facilities <ul style="list-style-type: none"> i. Calculations shown for pipes, inlets, channels, etc. using the City of Hurst iSWM Criteria Manual ii. Calculations shown for streets using the City of Hurst iSWM Criteria Manual iii. Storm sewer plans and profiles iv. City of Hurst Standard “Miscellaneous Drainage Details (4 sheets)
		<ul style="list-style-type: none"> D. Final plans for meeting water quality requirements (City of Hurst iSWM Criteria Manual Section 3.2) <ul style="list-style-type: none"> i. Option 1: Provide final scoresheet and show locations of practices in the plans. ii. Option 2: Show the types and locations of BMPs proposed with water quality volume calculations. iii. Option 3: Discuss the requirements for approval with the Public Works Director or designee
		E. Show and label all existing and proposed easements.
		F. Final downstream assessment report showing no adverse impacts
		G. Determination of public or private maintenance for drainage controls
		H. Maintenance and inspection plan for all drainage controls

CITY OF HURST
Public Works Department
FINAL PLAT (REPLAT) AND ENGINEERING PLAN CHECKLIST



INDICATE IF DATA IS:

ON PLANS N/A

ON PLANS N/A

IV. FEES AND AGREEMENTS

- A. Streetmarker fees – Paid prior to construction permits
- B. Escrow fees – Paid prior to construction permits (water, sewer, street, etc.)
- C. Developer participation agreement – Submit with final plat for City Council approval (Paid by City upon project acceptance)

V. MISCELLANEOUS

- A. Indicate other utilities (i.e. gas, electric, cable, telephone)
- B. Indicate existing and proposed street light locations

Owner/Developer Signature _____

Consulting Engineer Signature _____

<u>FOR CITY USE</u>		
Received By: _____	Date: _____	Time: _____
Fees Paid: _____		
Reviewed By: _____	Date: _____	

5.3 Tarrant County Rainfall Data

Coefficients		Return Period (Years)						
		1	2	5	10	25	50	100
e		0.82169	0.81144	0.81423	0.79952	0.79381	0.78265	0.77982
b		43.653	51.393	71.154	77.103	90.982	97.721	110.202
d		8	9	12	12	13	13	14
Hours	Minutes	Rainfall Intensity (inches per hour)						
0.083	5	5.31	6.04	7.08	8.00	9.17	10.18	11.09
	10	4.06	4.71	5.74	6.51	7.55	8.40	9.24
	11	3.88	4.52	5.54	6.29	7.30	8.12	8.95
	12	3.72	4.35	5.35	6.08	7.07	7.87	8.68
0.250	13	3.58	4.18	5.18	5.88	6.85	7.63	8.43
	14	3.44	4.04	5.01	5.70	6.65	7.41	8.20
	15	3.32	3.90	4.86	5.53	6.46	7.20	7.98
	16	3.21	3.77	4.72	5.37	6.28	7.01	7.77
	17	3.10	3.65	4.59	5.22	6.12	6.82	7.57
	18	3.00	3.54	4.46	5.08	5.96	6.65	7.39
	19	2.91	3.44	4.34	4.95	5.81	6.49	7.21
	20	2.82	3.34	4.23	4.83	5.67	6.33	7.05
	21	2.74	3.25	4.13	4.71	5.54	6.19	6.89
	22	2.67	3.17	4.03	4.60	5.41	6.05	6.74
0.500	23	2.60	3.09	3.94	4.49	5.29	5.91	6.60
	24	2.53	3.01	3.85	4.39	5.18	5.79	6.46
	25	2.47	2.94	3.76	4.30	5.07	5.67	6.33
	26	2.41	2.87	3.68	4.21	4.97	5.56	6.21
	27	2.35	2.81	3.60	4.12	4.87	5.45	6.09
	28	2.30	2.74	3.53	4.04	4.77	5.34	5.98
	29	2.25	2.69	3.46	3.96	4.68	5.24	5.87
	30	2.20	2.63	3.39	3.88	4.60	5.15	5.76
	31	2.15	2.58	3.33	3.81	4.51	5.06	5.66
	32	2.11	2.52	3.27	3.74	4.43	4.97	5.57
0.750	33	2.06	2.48	3.21	3.68	4.36	4.88	5.47
	34	2.02	2.43	3.15	3.61	4.28	4.80	5.38
	35	1.99	2.38	3.10	3.55	4.21	4.72	5.30
	36	1.95	2.34	3.04	3.49	4.14	4.65	5.22
	37	1.91	2.30	2.99	3.43	4.08	4.57	5.14
	38	1.88	2.26	2.94	3.38	4.01	4.50	5.06
	39	1.85	2.22	2.90	3.33	3.95	4.44	4.98
	40	1.81	2.18	2.85	3.27	3.89	4.37	4.91
	41	1.78	2.15	2.81	3.22	3.84	4.31	4.84
	42	1.75	2.11	2.76	3.18	3.78	4.25	4.77
1	43	1.73	2.08	2.72	3.13	3.73	4.19	4.71
	44	1.70	2.05	2.68	3.09	3.67	4.13	4.65
	45	1.67	2.02	2.65	3.04	3.62	4.07	4.58
	46	1.65	1.99	2.61	3.00	3.57	4.02	4.52
	47	1.62	1.96	2.57	2.96	3.53	3.97	4.47
	48	1.60	1.93	2.54	2.92	3.48	3.91	4.41
	49	1.57	1.91	2.50	2.88	3.44	3.87	4.36
	50	1.55	1.88	2.47	2.84	3.39	3.82	4.30
	51	1.53	1.85	2.44	2.81	3.35	3.77	4.25
	52	1.51	1.83	2.41	2.77	3.31	3.72	4.20
2	53	1.49	1.81	2.38	2.74	3.27	3.68	4.15
	54	1.47	1.78	2.35	2.71	3.23	3.64	4.10
	55	1.45	1.76	2.32	2.67	3.19	3.60	4.06
	56	1.43	1.74	2.29	2.64	3.16	3.55	4.01
	57	1.41	1.72	2.26	2.61	3.12	3.51	3.97
	58	1.40	1.69	2.24	2.58	3.09	3.48	3.92
	59	1.38	1.67	2.21	2.55	3.05	3.44	3.88
	60	1.36	1.65	2.19	2.52	3.02	3.40	3.84
	120	0.81	1.00	1.34	1.55	1.88	2.13	2.42
	180	0.59	0.73	0.98	1.15	1.40	1.59	1.81
360	0.34	0.42	0.57	0.68	0.83	0.95	1.09	
720	0.19	0.24	0.33	0.40	0.48	0.56	0.64	
1440	0.11	0.14	0.19	0.23	0.28	0.33	0.38	

5.4 Runoff Coefficients for Rational Method

The City of Hurst approves the use of the Rational Method under the conditions detailed in Section 3.1 of the Criteria Manual and Section 1.2 of the Hydrology Chapter of the Technical Manual. In place of the runoff coefficients or “C” coefficients provided in the Hydrology Chapter of the Technical Manual the City of Hurst has designated the approved “C” coefficients in the table below that shall be used in Rational Method calculations.

City of Hurst Runoff Coefficients	
Land Use	C coefficient
Business	0.95
Industrial	0.90
Residential	0.60
Park	0.40

5.5 Structural Controls in Series

For treatment trains with two BMPs in series the following equation is used.

$$E = A + B - \{(A * B)/100\}$$

where:

E = total efficiency

A = efficiency of first or upstream BMP

B = efficiency of second BMP

For treatment trains with three BMPs in series the following equation is used.

$$E = 0.95 * [A_B + C - \{(A_B * C)/100\}]$$

where:

E = total efficiency

$A_B = A + B - \{(A * B)/100\}$

A = efficiency of first or upstream BMP

B = efficiency of second BMP

C = efficiency of third or downstream BMP

5.6 City of Hurst Draft Water Quality Option 1:

Table 5.1 – Score Requirements for Water Quality Option 1

Type of Site	Minimum Points Required
All Sites	35

Table 5.2 – Variables for Calculating Water Quality Option 1

Variable	Description
A = _____ acres	Area of rooftops that drain directly to a designated pervious area.
B = _____ acres	Total area of rooftops on site.
C = _____ acres	Area of impervious parking lots that drain directly to a designated pervious area.
D = _____ acres	Total area of impervious parking lots.
E = _____ acres	Total impervious area (including rooftops, parking lots, sidewalks, driveways, etc.).
F = _____ acres	Impervious area that is directed towards an approved rain harvesting device.
G = _____ acres	Area of the site that is draining to an approved water quality control.
H = _____ acres	Area of natural features on the site. Natural features include existing Special Flood Hazard Areas (SFHA), areas with A and B soil types, and areas with trees greater than 6" in diameter and on the approved plant species list.
I = _____ acres	Total site area.

Table 5.3 – Scoresheet for Water Quality Option 1

	Practice	Ratio of Area Using Practice (Based on Variables in Table 5.2)	Maximum Points	Points Earned (Ratio of Area * Max. Points)
1	Drain rooftops to pervious areas	$A / B = \underline{\hspace{2cm}}$	10	
2	Drain parking lots to pervious areas	$C / D = \underline{\hspace{2cm}}$	15	
3	Drain impervious area to a rain water harvesting system	$E / F = \underline{\hspace{2cm}}$	15	
4*	Reduce existing impervious area	Reduction of $\geq 10\%$: 15		
		Reduction of $\geq 15\%$: 25		
		Reduction of $\geq 20\%$: 35		
5	Site runoff is drained towards a primary water quality structural control	$G / I = \underline{\hspace{2cm}}$	35	
6**	Preserve natural features	Preserve 90-100%: 35		
		Preserve 80-90%: 25		
		Preserve 70-80%: 15		
Actual Points Earned =				

* Practice is only eligible for redevelopment

** Practice is only eligible for new development

Approved Plant Species

The City of Hurst provides an approved general plant list in Table 21-2 of the Landscape Ordinance No. 1777. In addition to the general plant list, the City of Hurst accepts plants listed in the iSWM Landscape Technical Manual as long as they are not deemed undesirable by the City. A list of undesirable plants is listed below:

- Cottonwood trees
- Mulberry trees
- Sycamore trees
- Ash trees
- American Elm trees
- Any turfgrass other than Bermuda

Pervious Area Design Criteria:

- Drainage areas to a single pervious area cannot exceed 2 acres.
- Runoff should be distributed across the pervious area as sheet flow. An effective flow spreader is a pea gravel diaphragm (ASTM 448 size no. 6, 1/8" to 3/8").
- Slopes of pervious areas must be at or below 2%.
- Pervious areas must be vegetated.
- The flow path across the pervious area must be at least 10 feet.
- Pervious areas must be located on property controlled by the Owner.

Rain Water Harvesting

Rain water harvesting systems should be sized to accommodate for volume of runoff and the volume being used for irrigation or other purposes.

Allowable BMPs


Primary water quality structural controls allowed by the City of Hurst include bioretention ponds, enhanced swales, infiltration wells and trenches, stormwater ponds, and wetlands. The use of other equivalent site development controls or proprietary controls will require written approval and will be at the discretion of the Public Works Director or designee. Design criteria for these controls are located in the iSWM Technical Manual under the Site Development Controls section.

Allowable Concessions

For development meeting the water quality requirements the following concessions may be allowed:

- Up to 50% of interior parking landscaped area may be placed outside paved boundaries if designated to a stormwater conservation easement.
- 10% of required parking may be permanently set aside as a parking reduction to be used as a stormwater conservation easement.
- Parking in excess of the maximum allotment may be allowed when permeable pavement is used and where minimum required parking is 100 spaces or greater.

5.7 Example Storm Drain Line Designations and Call Outs

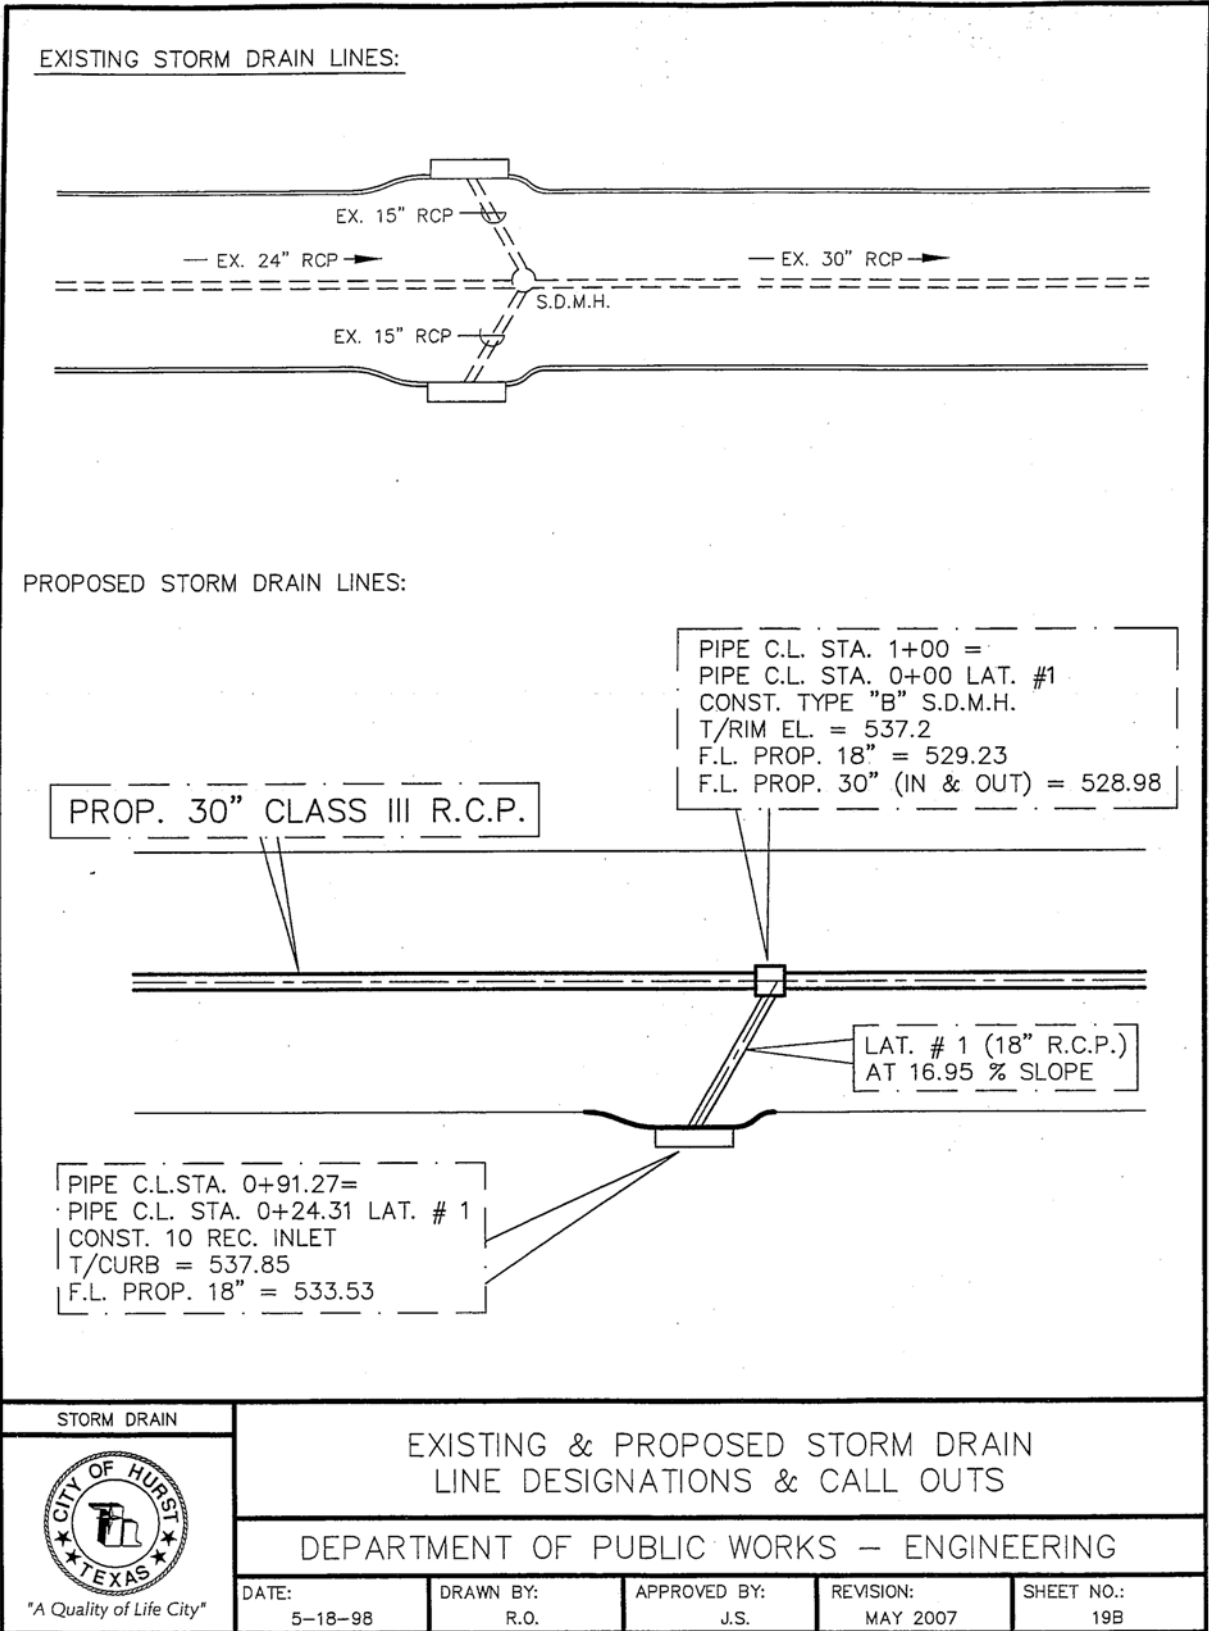

DWG. NAME: L:\USER\ROBERTO\ACAD\STANDARDS\STORM DRAIN LINE.DWG



"A Quality of Life City"